



2023 Watershed Overview of Wastewater Treatment Plant Performance

August 2024

Report Prepared by Simion Tolnai
Grand River Conservation Authority



TABLE OF CONTENTS

Executive Summary	v
Plant Flows.....	v
Treatment Performance.....	vi
Data Integrity Checks	vii
Grand River Impacts.....	viii
Plant Loading	ix
Bypasses and Overflows	x
Introduction	1
Background	3
Data Collection Methodology	6
Wastewater Treatment Plant Reporting and Performance	7
Data Reporting	7
Final Effluent Quality	7
Total Phosphorus (TP).....	7
Total Ammonia Nitrogen (TAN).....	7
Voluntary Effluent Quality Performance Targets.....	8
Influence of WWTPs on the Grand River	13
TP Loading to Lake Erie from Grand River.....	13
Precipitation	14
Recent studies	17
Bypasses and Overflows	17
Data Integrity Checks	19
Wastewater Treatment Plant Loading Summary	22
Influent flow	22
Raw Influent Loads	29
TBOD Loading	29
TSS Loading	32
TKN Loading.....	32
TP Loading	32
Ratios	36
Final Comments.....	39
Bibliography	40
Appendix 1: Sludge Accountability and Water Balance Summary	42

List of Tables

Table 1: WWTP Effluent flow as a percentage of Grand River total flow	viii
Table 2: Summary of 2012 to 2023 watershed WWTP raw influent concentrations.....	ix
Table 3: Summary of 2012 to 2023 watershed WWTP loading metrics	ix
Table 4: Voluntary effluent quality performance targets for TP and TAN	8
Table 5: Percentage of months plants meeting TP and TAN targets 2023.....	10
Table 6: Wastewater effluent TP loading and flow-weighted concentration to the Grand River .	12
Table 7: Wastewater effluent TAN loading and flow-weighted concentrations to the Grand River	12
Table 8: WWTP effluent flow as a percentage of Grand River total flow over 2012-2023 period.	15
Table 9: Summary of 2019-2023 Sludge Accountability analyses	21
Table 10: Summary of 2019-2023 Water Balance analyses of lagoons.....	22
Table 11: Annual average raw influent cBOD and TBOD concentrations reported by Grand River watershed plants in 2016-2023	29
Table 12: Summary of sludge accountability analysis results	43
Table 13: Summary of Water Balance results from plants that report on it	44

List of Figures

Figure 1: Total reported WWTP average daily flow and population from 2012-2023	v
Figure 2: Flow-weighted effluent TP concentrations and total loading	vi
Figure 3: Flow-weighted summer and winter effluent TAN concentrations and total loading.....	vii
Figure 4: Map showing locations of WWTPs in the watershed	2
Figure 5: Composite Correction Program Performance Pyramid	4
Figure 6: Area-Wide Optimization Model.....	5
Figure 7: Number of plants meeting TP and TAN targets in all months of discharge (2012-2023)	9
Figure 8: Percentage of months meeting the voluntary targets for all plants combined from 2012-2023.....	11
Figure 9: Annual TP Load to Lake Erie at York	14
Figure 10: Total annual precipitation (in mm) at selected locations across the watershed. Typical range is based on 5th and 95th percentile of historical observations over the past 50 years.	16
Figure 11: Number of low, moderate and high-risk bypasses from 2013-2023	18

Figure 12: Volume of low, moderate and high-risk bypasses from 2013-2023.....	19
Figure 13: ADF and Nominal Design Flow of watershed WWTPs	25
Figure 14: Annual average flow as a percentage of rated plant capacity	26
Figure 15: Per capita influent flow	27
Figure 16: Ratio of peak day flow to annual average flow	28
Figure 17: Per Capita TBOD Load	31
Figure 18: Per Capita TSS Load	33
Figure 19: Per Capita TKN Load	34
Figure 20: Per Capita TP Load.....	35
Figure 21: Ratio of Raw TSS to Raw TBOD	37
Figure 22: Ratio of Raw TKN to Raw TBOD.....	38

Acronyms and Abbreviations

ADF	Average daily flow
c BOD	Carbonaceous 5-day biochemical oxygen demand
CCP	Composite Correction Program
ECA	Environmental Compliance Approval (formerly called Certificate of Approval)
EPA	US Environmental Protection Agency
GRCA	Grand River Conservation Authority
I/I	Inflow/ Infiltration
MECP	Ontario Ministry of the Environment, Conservation and Parks
NDF	Nominal Design Flow (listed in plant's ECA)
OCWA	Ontario Clean Water Agency
PWQO	Provincial Water Quality Objectives
TAN	Total ammonia nitrogen
TBOD	Total 5-day biochemical oxygen demand
TKN	Total Kjeldahl nitrogen
TP	Total phosphorus
TSS	Total suspended solids
UIA	Un-ionized ammonia
WMP	Water Management Plan
WWOP	Watershed-wide Wastewater Optimization Program
WWTP	Wastewater treatment plant

EXECUTIVE SUMMARY

Since 2010, the Grand River Conservation Authority (GRCA) has been working collaboratively with local partners and the Ministry of the Environment, Conservation and Parks (MECP) to implement a Watershed-wide Wastewater Optimization Program (WWOP). A key program activity is the preparation of an annual report on effluent quality and plant loading for treatment facilities discharging in the Grand River watershed. The first annual report was produced for data collected in 2012. Year-to-year variations are used to evaluate the success of the program and track wastewater treatment plant (WWTP) impacts on the Grand River. Available performance and loading data for 28 of 30 wastewater treatment plants were voluntarily reported in 2023. These results were summarized in terms of treatment performance, data integrity, impacts on the Grand River, plant loading and bypasses and overflows and compared to results from previous years.

Plant Flows

Figure 1 shows the total average day flow (ADF) for all the reporting plants from 2012 to 2023. Additionally, the reported serviced population for each year is included on the secondary axis in orange. From 2012-2023 the reported population increased by 17% (or 1.5% per year) from about 805,200 people in 2012 to 938,400 in 2023 while the flows increased by 11%. Total plant flow can also be affected by variations in precipitation.

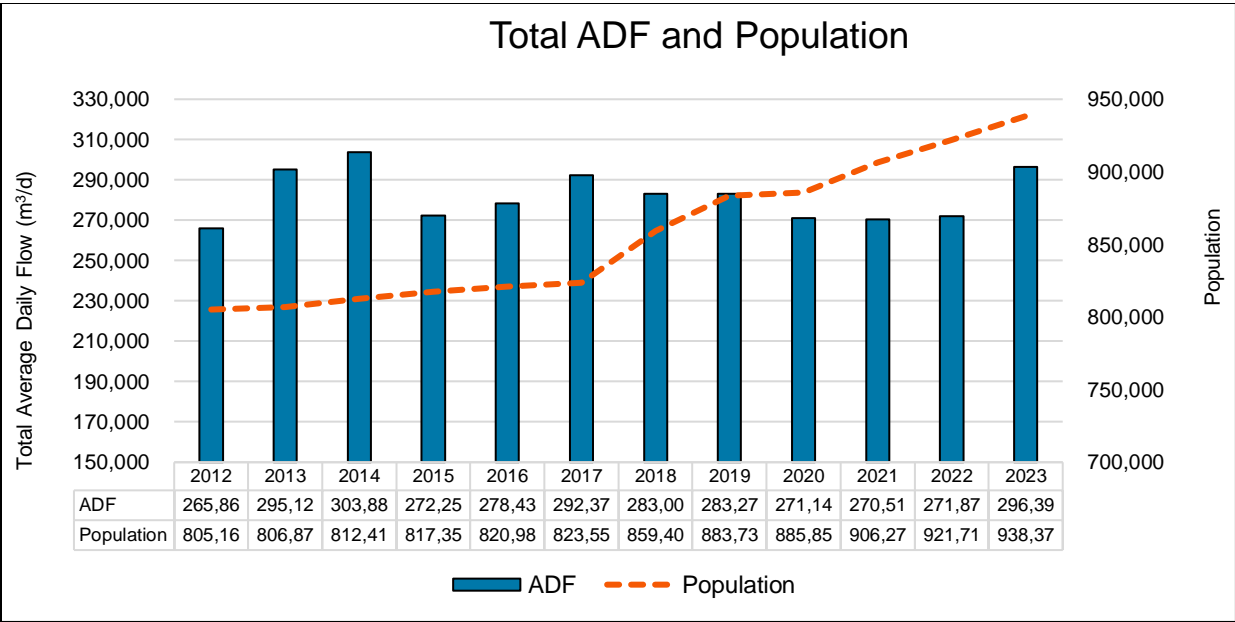


Figure 1: Total reported WWTP average daily flow and population from 2012 to 2023

Treatment Performance

Figure 2 and Figure 3 shows the final effluent total phosphorus (TP) and total ammonia nitrogen (TAN) flow-weighted average concentrations and the total loading from 2012 to 2023. The dashed line in Figure 2 represents the watershed-wide flow-weighted concentration target for TP, which is calculated based on each plant's average daily flow (ADF) multiplied by the corresponding TP target and the sum of these values is divided by the total ADF. This target can change year over year as the annual ADF changes.

With respect to the TP concentrations and loads in Figure 2, the following observations can be made:

- From 2022 to 2023, the TP flow-weighted concentration increased from 0.21 to 0.22 mg/L and the TP load increased from 21.1 to 23.3 tonnes; and
- From 2012 to 2023, the TP flow-weighted concentration decreased from 0.37 to 0.22 mg/L and the TP load from 36.0 to 23.3 tonnes.

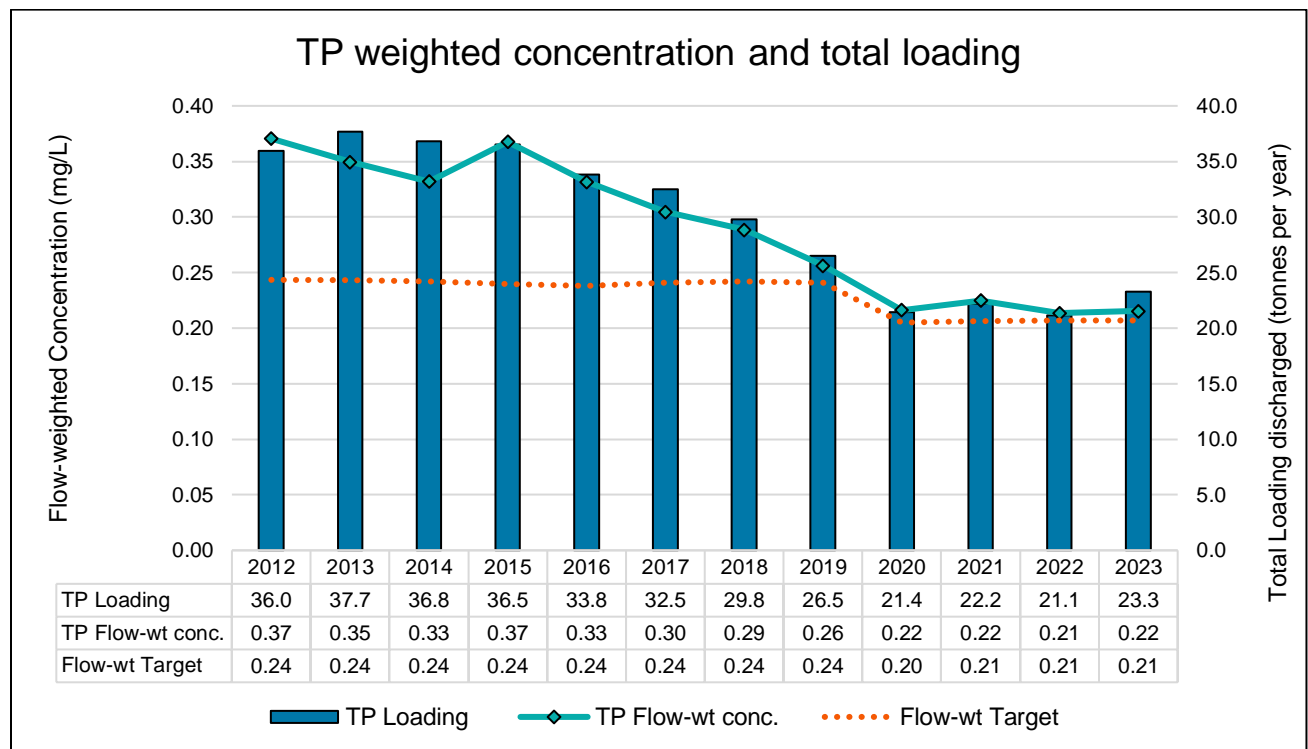


Figure 2: Flow-weighted effluent TP concentrations and total loading

With respect to Figure 3 showing the TAN loads and concentrations, the following comments are applicable:

- From 2022 to 2023 the summer TAN flow-weighted concentration increased from 0.3 to 0.6 mg/L and winter TAN flow-weighted concentration decreased from 0.9 to 0.8 mg/L. TAN total loading increased from 58 to 75 tonnes compared to the previous year.
- From 2012 to 2023, the overall total TAN flow-weighted concentration decreased from 9.8 to 0.7 mg/L and the total loading from 954 to 75 tonnes.

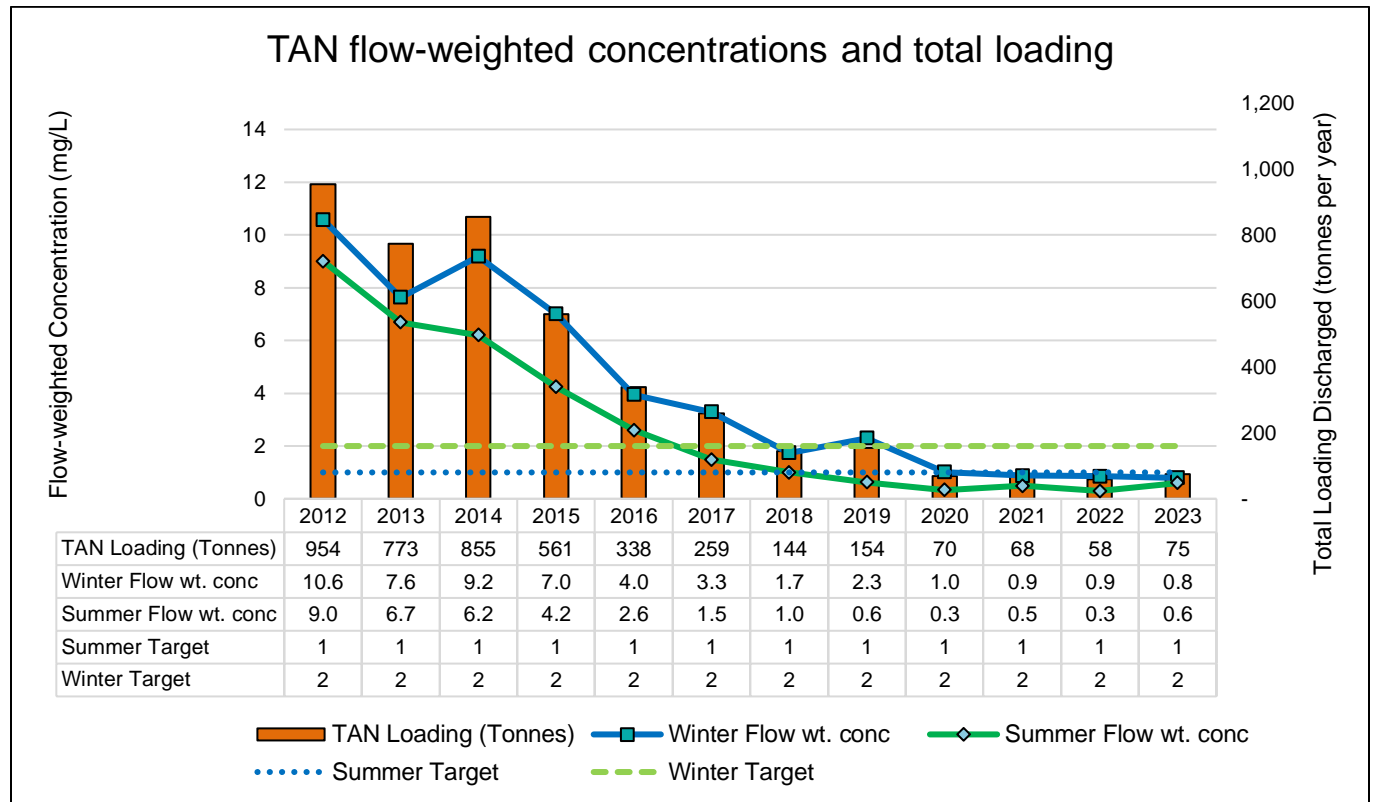


Figure 3: Flow-weighted summer and winter effluent TAN concentrations and total loading

Overall, both TP and TAN concentrations and loadings decreased steadily from 2012 to 2020 and have plateaued from 2020 to 2023.

Data Integrity Checks

A sludge accountability analysis compares the annual amount of sludge reported by a mechanical plant to the amount of sludge projected based on plant loadings and removal. Conducting this analysis can help to determine if monitoring is truly representative. In 2023, sludge accountabilities were reported for 22 plants in the watershed. For 13 of the plants, the accountability “closed” within $\pm 15\%$.

A water balance analysis compares the annual amount of measured net precipitation on the surface area of a lagoon system to the annual amount of projected net precipitation using lagoon level measurements, total influent, and total effluent flows of a lagoon system. This analysis can help to determine if the flow measurement devices at a lagoon are accurate. In 2023, water balances were reported for three lagoon systems in the watershed. One of these analyses closed within $\pm 15\%$.

Grand River Impacts

Table 1 summarizes the impact of total annual average discharge of effluent from wastewater treatment plants on the total flow in the Grand River.

Table 1: WWTP Effluent flow as a percentage of Grand River total flow

Parameter	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023
% Annual Average Flow	6.8%	3.1%	2.6%	5.0%	4.7%	3.5%	3.6%	3.7%	4.5%	5.1%	5.5%	5.0%
% August Average Flow	13.9%	5.4%	9.5%	11.5%	9.0%	7.3%	8.7%	10.3%	10.2%	12.6%	14.5%	7.1%

The year-to-year variations in Table 1 are largely a function of precipitation and weather in the watershed in any given year. The percentage of flows in August is also shown, as flows in this month are typically the lowest and treated wastewater makes up a larger portion of river flow. In 2017 and 2019, precipitation was above average. In 2023 following a significantly dry September, the watershed saw slightly higher precipitation levels through the months of October and November, but the observed rainfall levels are still below long-term averages. Over the entire year of 2023, the precipitation levels appear to approach normal long-term averages (Taleban, 2023).

Some improvements in the water quality of the Grand River have been noted due to recent WWTP upgrades and optimization efforts. Upgrades at the Kitchener and Waterloo WWTPs completed in 2019 have allowed the plants to nitrify, resulting in lower concentrations of TAN, UIA and nitrite in the Grand River. The data collected in 2023 illustrate that the Region's largest plants had no statistically significant increase on TP and TAN concentrations, however during summer low-flow conditions the data showed exceedance of TP Provincial Water Quality Objectives (PWQO) downstream of Kitchener and Waterloo treatment plants (LGL Limited, 2024).

Plant Loading

Table 2 summarizes the 2023 median in comparison to 2012-2022 ranges and typical values for raw influent concentrations for Total 5-day biochemical oxygen demand (TBOD), total suspended solids (TSS), TP and total Kjeldahl nitrogen (TKN). These data are helpful to give a rough idea of typical concentrations for the plants in Grand River watershed as sometimes poor estimates of population play into the per capita loadings. Table 3 summarizes key process loading metrics for 2023 as well as typical values and the range of median reported values from 2012 to 2022. Per capita loadings are influenced by sampling, proportion of industry to residential loading and population values. The results in the tables enable plant owners and operators to compare loadings at their facilities to those at other plants in the watershed, which can be used to determine the impact of industrial discharges and may highlight concerns with unrepresentative sampling of raw influent.

Table 2: Summary of 2012 to 2023 watershed WWTP raw influent concentrations

Raw Influent concentrations	Watershed Median 2012-2022 (min - max)	Watershed Median 2023	Range of typical concentrations*
TBOD (mg/L)	183-251	221	120 -380
TSS (mg/L)	204-258	264	120 -370
TP (mg/L)	5-6	5	4-12
TKN (mg/L)	38-47	44	20-45

* (Eddy, 2003)

Table 3: Summary of 2012 to 2023 watershed WWTP loading metrics

Loading Measure	Watershed Median 2012-2022 (min - max)	Watershed Median 2023	Typical Value
Per capita flow (L/person/day)	280-351	296	350-500
ADF as % of Nominal Design	51%-to 66%	61%	Not Applicable
Peak day: Annual average flow	2.25–3.54	3.01	2.5–4.0

Loading Measure	Watershed Median 2012-2022 (min - max)	Watershed Median 2023	Typical Value
Per capita TBOD ¹ loading (g/person/day)	63 - 77	68.8	80
Per capita TSS loading (g/person/day)	69 - 93	85.4	90
Per capita TKN loading (g/person/day)	13 - 14	13.3	13
Per Capita TP loading (g/person/day)	1.6 – 2.0	1.7	2.1
Raw TSS:TBOD ratio	1.01 - 1.25	1.06	0.8 - 1.2
Raw TKN:TBOD ratio	0.17 - 0.23	0.20	0.1 - 0.2

Year-to-year variations in per capita flow, the average day flow as a percentage of the design flow and the ratio of the peak day to average day flow from Table 3 are largely due to differences in inflow and infiltration (I/I) related to precipitation.

Bypasses and Overflows

Bypasses and overflows are terms used to describe events that result in untreated or partially treated sewage reaching natural water bodies (Grand River Municipal Water Managers Working Group, 2009). Bypasses occur when parts of a treatment process are bypassed and partially treated wastewater discharges to the environment via the WWTP effluent outfall. Overflows occur when sewage enters the environment at a location other than the effluent outfall.

Bypasses/ overflows can be classified as low, moderate, or high according to the level of risk to downstream users. Overall, the total number of bypasses is 66 in 2023, a substantial increase from 21 events recorded in the previous year and similar in number to 2013, the year WWOP started monitoring these events. In terms of the volume of bypasses recorded in 2023 compared to the previous year, there is an increase from 27,195 to 88,053 cubic metres. Several low and moderate risk bypasses in 2023 occurred in February and December and were related to weather conditions generating high peak day flows to the WWTP.

¹ Some previously reported data was based on cBOD and may be less reliable. Research indicates that cBOD measurements of raw wastewater underestimate organic loading by 20 to 40% .

Effluent quality has improved since 2012 as a result of facility upgrades and optimization. These improvements have led to significant reductions in TP and TAN discharged to the Grand River. However, 2023 is the first year in recent years that both TP and TAN loading increased compared to the previous year. Five of the eight largest plants in the watershed did not consistently achieve their TP target in 2023. TP loading increased from 21.1 tonnes in 2022 to 23.3 tonnes in 2023, a 10% increase. TAN loading also increased compared to the previous year, from 58 tonnes in 2022 to 75 tonnes in 2023, an increase of 29% .

INTRODUCTION

The Grand River watershed has a population close to 1 million that is expected to reach 1.5 million by 2051 (GRCA, 2024). Based on data reported to the Grand River Conservation Authority (GRCA), wastewater from a total population of about 938,300 is treated by municipal and First Nations-owned facilities in the watershed while the remainder of the population is serviced by other means such as private septic systems. Significant population growth will result in more wastewater treatment plant (WWTP) effluent being discharged into the Grand River and its tributaries. There are 30 municipal and First Nations WWTPs that discharge their treated effluent into rivers in the watershed, as shown in Figure 4.

The organizations listed below are responsible for their operation:

- Township of Southgate
- Town of Grand Valley
- Township of Mapleton
- Township of Wellington North
- Township of Centre Wellington
- Region of Waterloo
- City of Guelph
- Oxford County
- County of Brant
- City of Brantford
- Haldimand County
- Six Nations of the Grand River
- Mississaugas of the Credit First Nation

The following report describes the background and objectives of the Grand River Watershed-wide Wastewater Optimization Program (WWOP) and provides a summary of performance data from 2012 to 2023 voluntarily reported by the program participants.

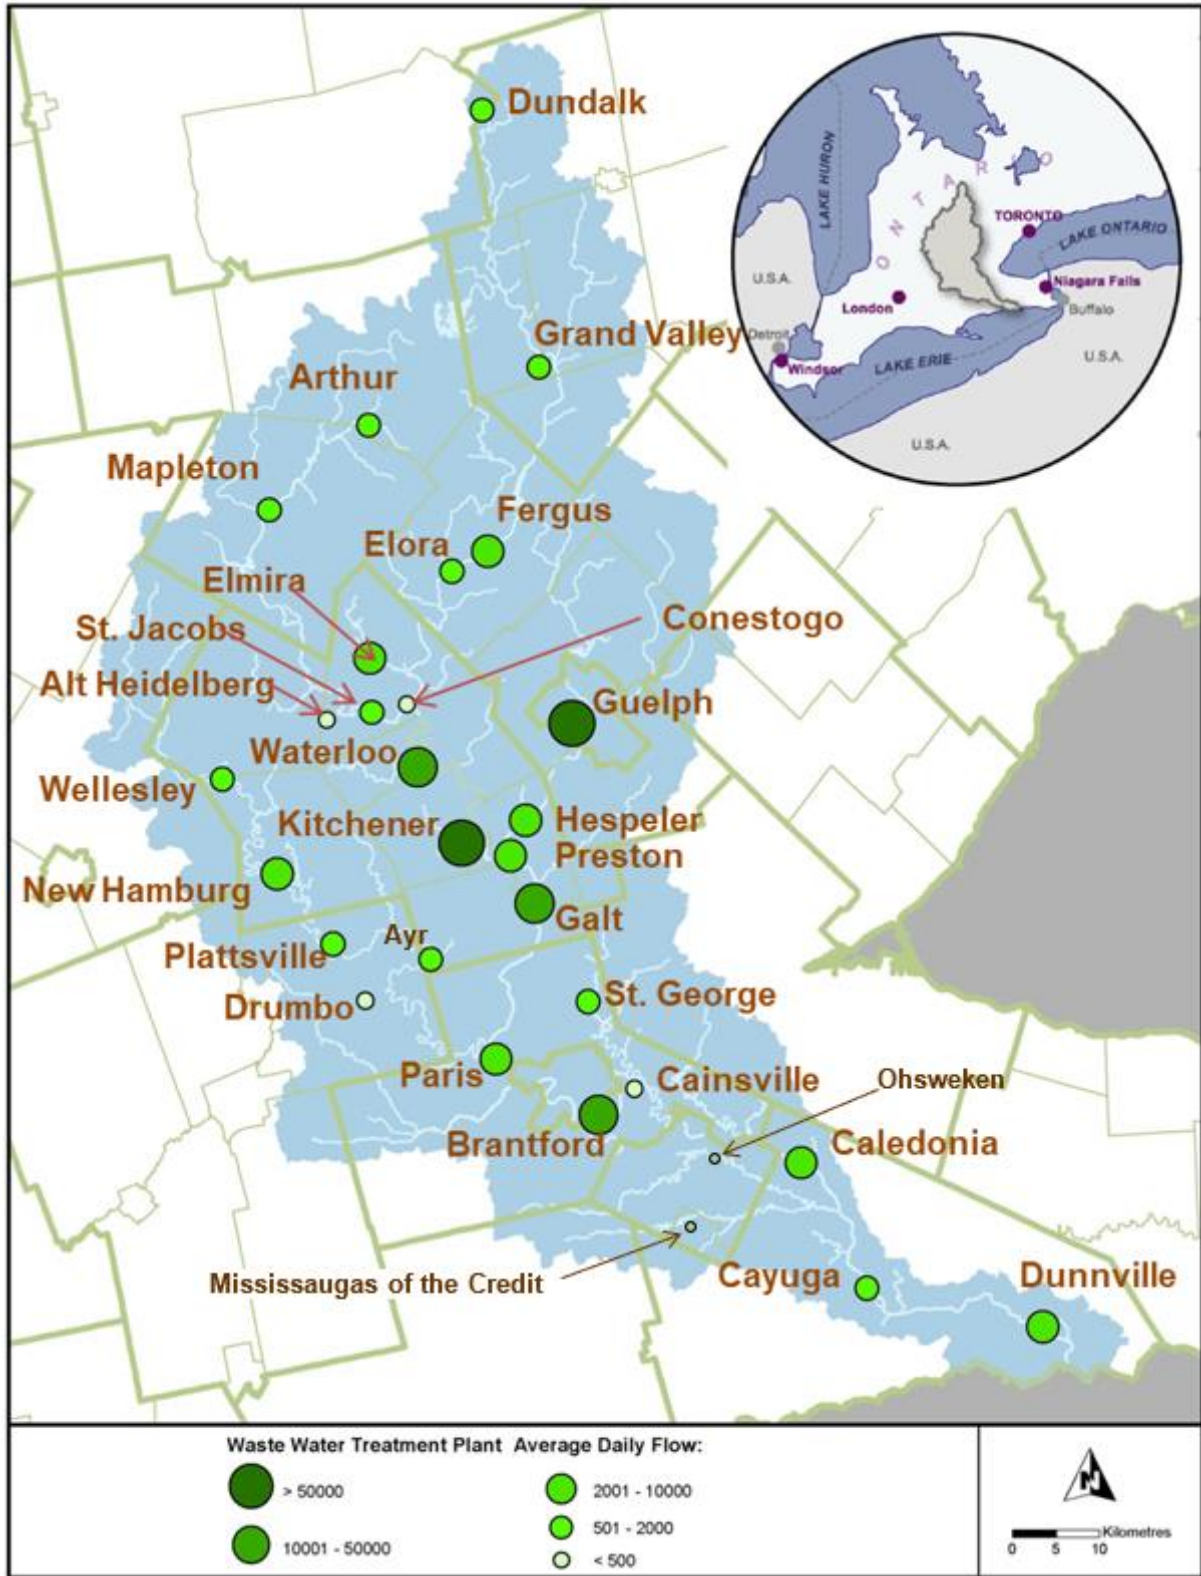


Figure 4: Map showing locations of WWTPs in the watershed

Background

The Grand River, located in southwestern Ontario, traverses a distance of approximately 310 km from its source near Dundalk to its point of discharge into Lake Erie at Port Maitland. The river and its tributaries serve as drinking water supply for four communities in the watershed in addition to providing other uses including a world-renowned brown trout tail-water fishery, active and passive recreation opportunities and productive agricultural lands (Anderson et al., 2011). Because of its cultural heritage and outstanding recreational opportunities, the Grand River and its major tributaries (Nith, Conestogo, Speed and Eramosa) were designated as a Canadian Heritage River in 1994 (Canadian Heritage Rivers System, 2017). Thirty WWTPs discharge treated effluent to the Grand or its tributaries.

Since 2010, GRCA has been working collaboratively with municipal and First Nations partners and the Ministry of the Environment, Conservation and Parks (MECP) to develop a Watershed-wide Wastewater Optimization Program (WWOP). The WWOP supports maintaining and improving water quality in the Grand River, as identified in the Grand River Water Management Plan (WMP) (Project Team, 2014). The WWOP is a voluntary program focused on skills development, knowledge transfer and capacity building within the watershed. The objectives of the program are to:

- Improve water quality in the Grand River and its tributaries as a direct result of improving wastewater treatment plant performance,
- Improve the water quality of Lake Erie,
- Tap the full potential of existing wastewater infrastructure and promote excellence in infrastructure management,
- Reduce vulnerability to climate change,
- Build and strengthen partnerships for wastewater optimization,
- Enhance partner capability and motivation,
- Leverage and learn from existing area-wide optimization programs in the United States (US), and
- Demonstrate strategies that can serve as a model for other areas of Ontario.

The WWOP promotes optimization across the watershed by encouraging the adoption of the Composite Correction Program (CCP). The US Environmental Protection Agency (EPA) developed the CCP as a structured approach to identify and systematically address performance limitations to achieve a desired effluent quality (EPA, 1989). The CCP was adapted for Ontario and documented in the handbook, “The Ontario Composite Correction Program Manual for Optimization of Sewage Treatment Plants” (PAI & WTC, 1996).

Additionally, the WMP suggests that adopting the CCP will help to reduce the overall loading of total phosphorus (TP) to the Grand River and, ultimately, to Lake Erie.

The CCP is based on the model shown in Figure 5. Good administration, design, and maintenance establish a “capable plant” and, by applying good process control, operators achieve a “good, economical” effluent.

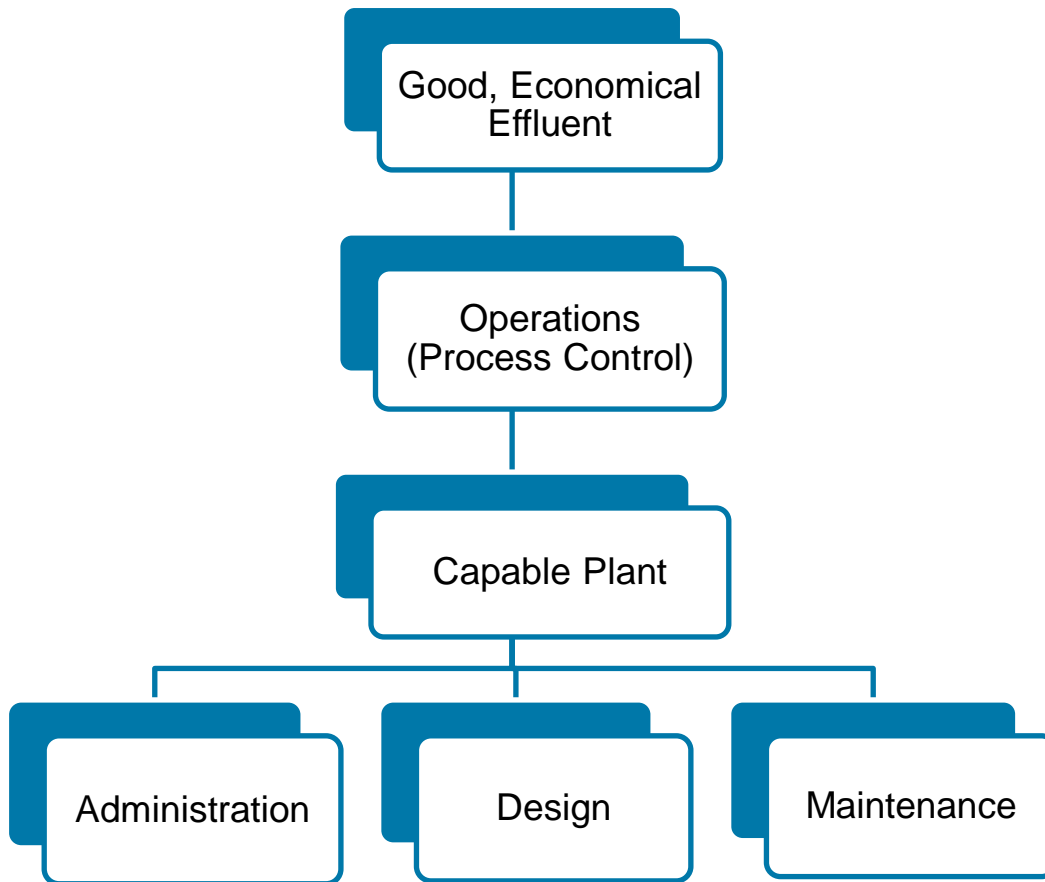


Figure 5: Composite Correction Program Performance Pyramid

The CCP is a two-step approach. The first step, a Comprehensive Performance Evaluation, evaluates and identifies performance limiting factors in the areas of administration, design, maintenance and operations of a wastewater treatment plant. If applicable, in Step 2 (Comprehensive Technical Assistance) a facilitator works with plant operators and managers to address and resolve any factors identified in Step 1. The watershed municipalities of Guelph, Haldimand County and Brantford have applied the CCP approach and have demonstrated its benefits, including improved effluent quality and re-rated capacity.

This approach has proven to be successful but is resource intensive when applied on a plant-by-plant basis. To address this challenge, an area-wide approach (as shown in Figure 6) was adopted based on the successful strategy for optimizing drinking water treatment systems in the US. Major components include: Status, Targeted Performance Improvement, and Maintenance. The model utilizes a proactive, continuous improvement approach to improve effluent quality.

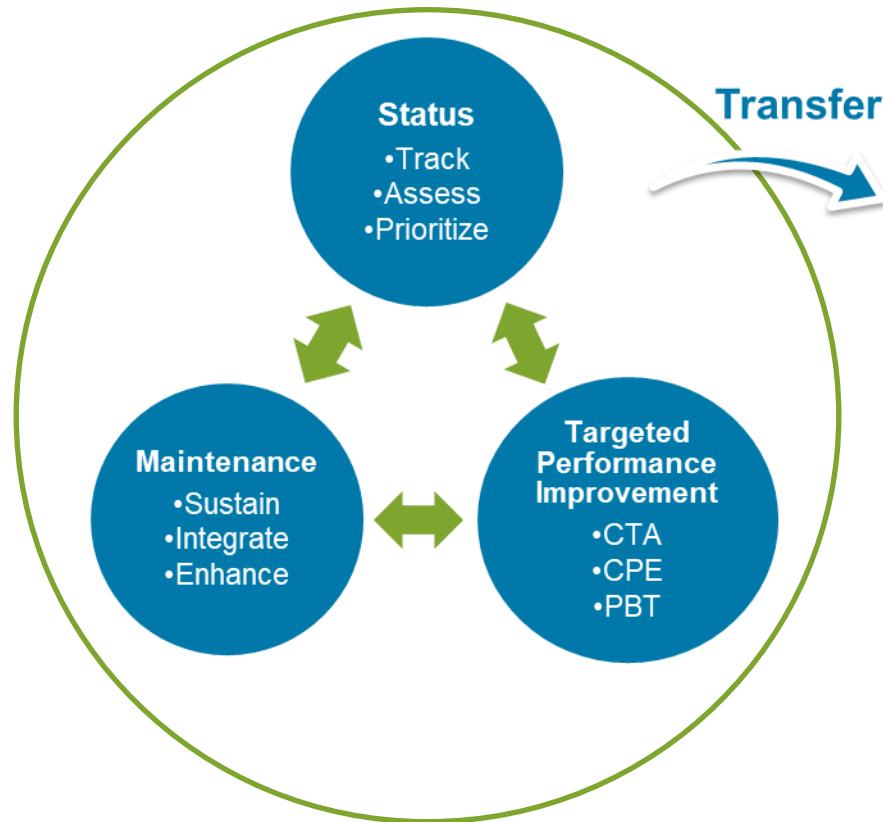


Figure 6: Area-Wide Optimization Model

Lake Erie Action Plan

Wastewater treatment plant optimization and **area-wide optimization** programs are highlighted as actions in the Canada-Ontario Lake Erie Action Plan as a means to reduce phosphorous loadings. (Canada-Ontario Agreement Partners, 2018)

A key activity under the Status Component is plant performance monitoring, used to demonstrate the success of the program, track changes over time and identify plants for further optimization work. Targeted Performance Improvement establishes voluntary performance targets and applies tools for achieving them. This component can include performance-based training, technical assistance, and other activities to develop and transfer skills. The purpose of the Maintenance component is to sustain and grow the program. As part of the maintenance component, a recognition program was developed to encourage participation and to acknowledge plants that:

- Participate in the WWOP,
- Apply CCP concepts,
- Meet all of the effluent compliance limits stated in their Environmental Compliance Approval (ECA),
- Adopt and achieve voluntary effluent quality performance targets,
- Participate in enhanced annual reporting (per capita loading, sludge accountability, etc.) and,
- Conduct annual sludge accountability analysis or water balance for lagoon systems.

The recognition awards based on 2023 plant data will be presented in the fall of 2024.

Additionally, the WWOP area-wide model includes a Transfer element to share and encourage other jurisdictions to adopt this approach.

Data Collection Methodology

Voluntary performance reporting across the watershed was initiated through several workshops that were held in 2010 and 2011 that brought wastewater operators, supervisors and managers together from communities within the watershed. These workshops provided information on optimization using the CCP and training on some of the tools used to evaluate WWTP performance. Workshop participants, with the assistance of peer facilitators, were encouraged to carry out the following performance calculations using their own plant data for 2012:

- Annual Average Daily Flow (ADF) as a percentage of Nominal Design Flow (NDF),
- Per capita influent flow,
- Ratio of peak day flow to ADF,
- Per capita TBOD, total suspended solids (TSS), and total Kjeldahl nitrogen (TKN) loading to the plant, and
- The ratios of TSS to TBOD and TKN to TBOD in the raw influent.

Additional workshops were held throughout 2012-2023 to review these performance metrics. Participants across the watershed were encouraged to calculate these metrics on an annual

basis, report the information back to the GRCA, as well as include them in performance reports to the MECP.

In addition to the metrics listed above, plant staff voluntarily submitted plant performance data including effluent TP and TAN concentrations. An Excel spreadsheet template was provided to plant owners and operators for data submission.

This report summarizes 2023 plant data and compares it to 2012-2022 data.

WASTEWATER TREATMENT PLANT REPORTING AND PERFORMANCE

Data Reporting

For 2023, 28 of the 30 WWTPs voluntarily reported their performance to the GRCA. All of these treatment plants reported their data using an Excel spreadsheet template. In presenting summaries of the data in the following sections, the plants are ranked from largest to smallest in terms of flow treated.

Final Effluent Quality

Total Phosphorus (TP)

TP is being targeted for improvement in the WWOP since “a high concentration of phosphorus in most rivers and streams in the Grand River watershed has long been recognized as an issue as it is the primary nutrient that promotes nuisance growth of aquatic plants and algae in the rivers” (Project Team, 2014). Over the past decade, zones of low oxygen, as a result of excessive algal growth, have been increasing in Lake Erie causing significant impact on the lake’s environment and Canadian economy (Canada-Ontario Agreement Partners, 2018). In early 2018, the Canada-Ontario Lake Erie Action Plan on achieving phosphorus loading reductions in Lake Erie from Canadian sources was finalized. According to 2003 - 2013 data, “Canadian sources contribute 54 percent of the total phosphorus load to the eastern basin, with the majority of this coming from one tributary - the Grand River” (Canada-Ontario Agreement Partners, 2018). This is another important reason to reduce phosphorous levels in the Grand River and its tributaries.

Total Ammonia Nitrogen (TAN)

Nitrate and ammonia can have direct toxic effects on aquatic life at high concentrations and TAN acts as an oxygen scavenger that reduces the dissolved oxygen (DO) concentration in water. TAN is being targeted under the WWOP since “high levels of un-ionized ammonia occur in the Grand River watershed in reaches downstream of wastewater treatment plants” (Project

Team, 2014). Un-ionized ammonia is the toxic component of total ammonia nitrogen. As the pH and temperature increase, the amount of un-ionized ammonia increases as well.

Voluntary Effluent Quality Performance Targets

The Grand River Water Management Plan recommends that “watershed municipalities who own WWTPs adopt voluntary effluent quality performance targets that go beyond the compliance objectives as stated in ECAs” to achieve the goal of improved water quality in the watershed. (Project Team, 2014). The proposed voluntary effluent targets are set out in Table 4. The TP targets were established based on demonstrated performance across the province and within the watershed for various levels of treatment (e.g. separate targets were established for secondary and tertiary treatment). Since nitrification is less effective in colder temperatures, there are different targets for TAN in “summer” (May to October) and “winter” (November to April) periods.

Table 4: Voluntary effluent quality performance targets for TP and TAN

Treatment Type	TP Target (monthly average mg/L)	Summer ¹ TAN Target (monthly average mg-N/L)	Winter ¹ TAN Target (monthly average mg-N/L)
Lagoon	0.30	Meet ECA objectives, if any	Meet ECA objectives, if any
Tertiary Lagoon	0.15	Meet ECA objectives, if any	Meet ECA objectives, if any
Secondary	0.30	1.0	2.0
Tertiary	0.15	1.0	2.0

Notes: ¹ “summer” is May to October, “winter” is November to April

Figure 7 shows the number of plants meeting the TP and TAN targets in all months of discharge, from 2012 to 2023. In 2023, 28 plants reported their monthly final effluent TP and TAN and of those plants, 12 met the TP target in each month and 18 met the TAN target in each month. Table 5 shows the percentage of months the TP and TAN targets were achieved in 2023 for each plant. The Table 5 cells are color coded with, green cells showing that the targets were achieved in more than 90% of the months of discharge, yellow cells showing that the targets were achieved between 50% to 90% of the months of discharge and the red cells showing that the targets were met in less than 50% of the months of discharge. Blank cells are plants with no TAN target. Achieving the targets can vary from year-to-year, due to changing factors such as staffing, weather conditions, equipment maintenance or operating costs. This shows the need for ongoing engagement of WWOP to support plants.

Figure 8 shows the proportion of months that all plants combined met the TP and TAN targets from 2012 to 2023. A percentage is used because some plants do not discharge year-round. Additionally, there are two plants that do not have a target for TAN. As presented in Figure 8, the TP targets were achieved 62% in 2012 and 76% in 2023 respectively. Overall, the achievement of TAN targets has improved 11% since the start of the program from 75% in 2012 to 83% in 2023. The ultimate goal is to meet the voluntary targets 100% of the time.

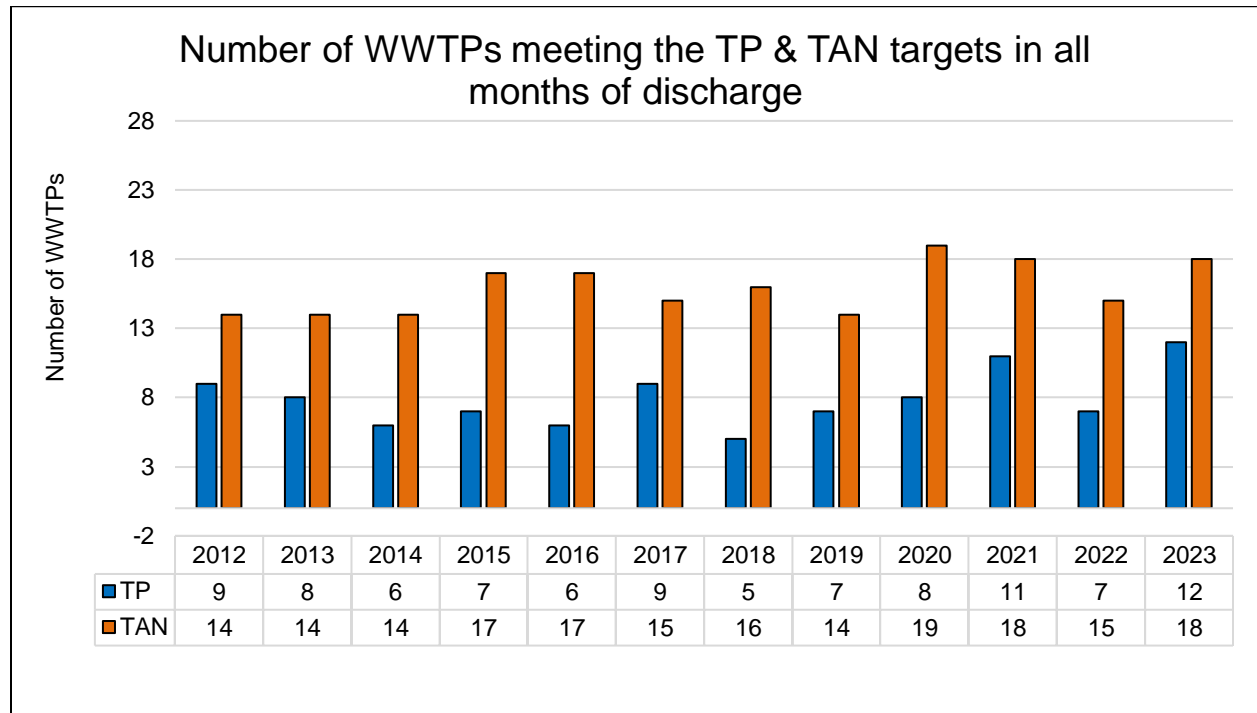


Figure 7: Number of plants meeting TP and TAN targets in all months of discharge (2012-2023)

Table 6 shows the annual average effluent TP loadings from all WWTPs combined for the years 2012 to 2023, as well as flow-weighted TP concentrations. For a majority of plants, the TP loading was calculated based on the product of each plant’s monthly average flow and its corresponding monthly average effluent TP concentration. For plants that did not report monthly data, the TP loading was based on the annual average flow and TP concentration. The flow-weighted concentrations were calculated by dividing the total combined loading by the total average flow. There was a 10% increase in TP loading in 2023 from 2022, largely as a result of increased loadings from some of the larger WWTPs in the watershed, including Kitchener, Waterloo, and Galt WWTPs. The flow-weighted concentrations in 2023 are also higher than the previous year. From 2012 to 2023 the TP loadings and flow-weighted concentrations have dropped by 35 and 42% , respectively.

Table 5: Percentage of months plants met TP and TAN targets in 2023.

WWTP	TP	TAN
Kitchener	33%	100%
Guelph	92%	67%
Waterloo	33%	92%
Brantford	100%	100%
Galt	0%	67%
Preston	92%	100%
Hespeler	33%	67%
Paris	75%	100%
Fergus	25%	100%
Dunnville	100%	50%
Elmira	83%	100%
New Hamburg	75%	100%
Caledonia	100%	100%
Elora	75%	100%
Ayr	100%	100%
Arthur	57%	100%
Grand Valley	100%	100%
Dundalk	100%	No target
St. Jacobs	83%	100%
Wellesley	50%	92%
Cayuga	100%	100%
Mapleton	100%	60%
St. George	83%	100%
Plattsville	100%	100%
Drumbo	42%	0%
Cainsville	100%	No target
Heidelberg	100%	100%
Conestogo	100%	100%

"Voluntary Targets

A study modelling future river water quality conditions suggests that water quality will incrementally improve with the adoption of effluent quality performance targets achieved through enhanced process control techniques as set out in the CCP." (Project Team, 2014)

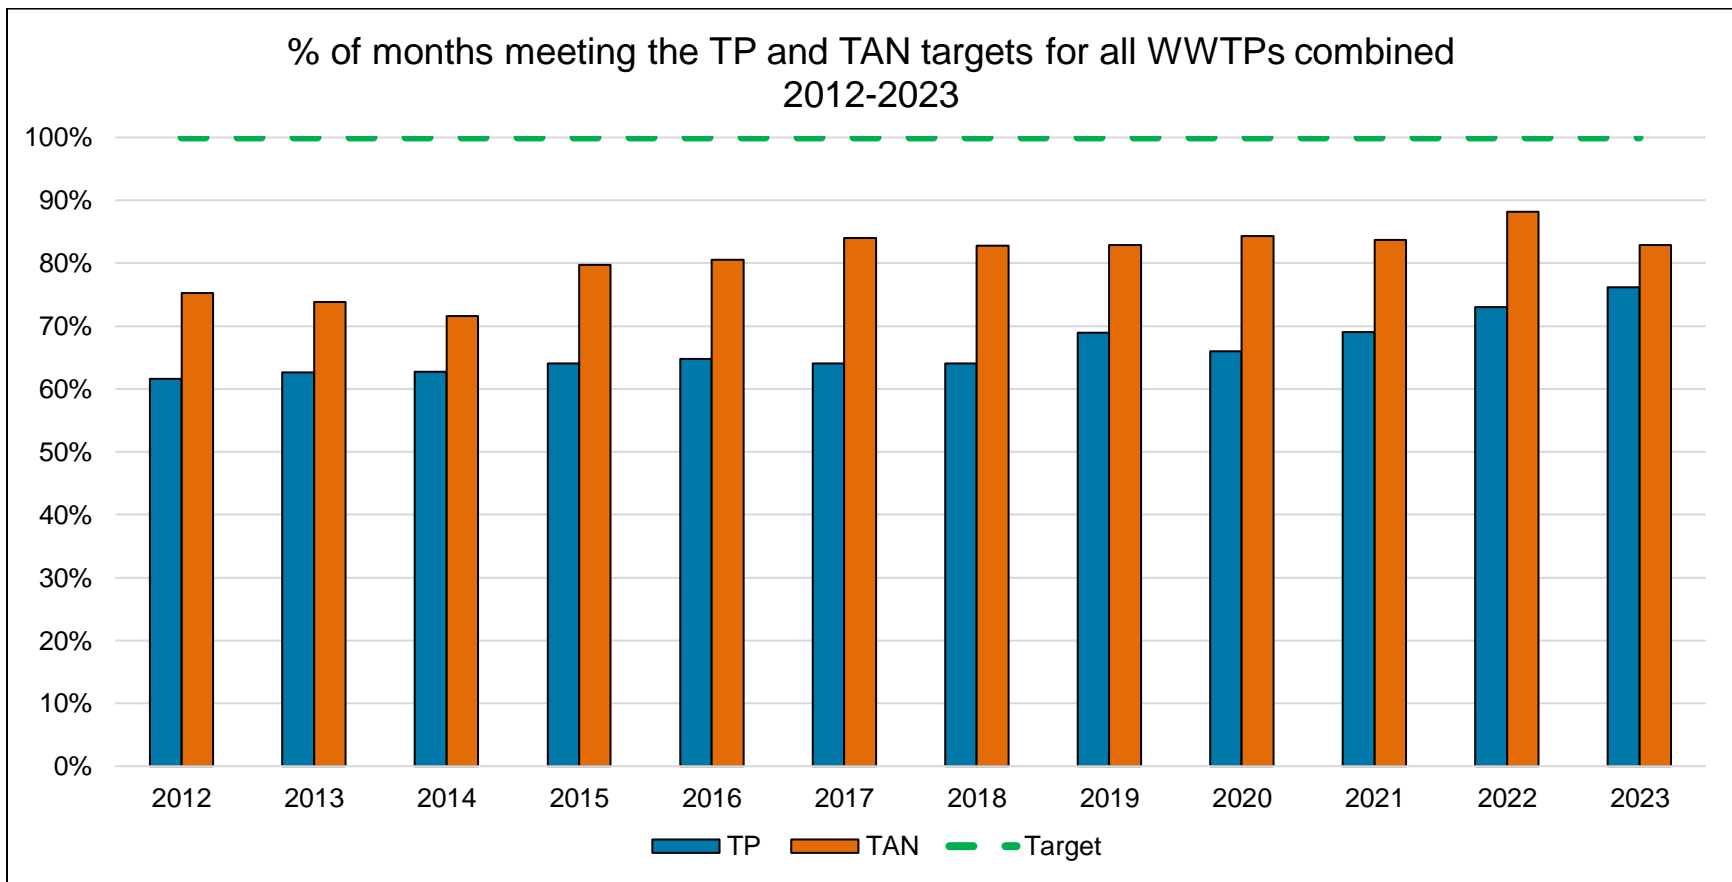


Figure 8: Percentage of months meeting the voluntary targets for all plants combined from 2012-2023

Table 6: Wastewater effluent TP loading and flow-weighted concentration to the Grand River

Year	Loading (tonne)	Flow-Weighted Concentration (mg/L)
2012	36.0	0.37
2013	37.7	0.35
2014	36.8	0.33
2015	36.5	0.37
2016	33.8	0.33
2017	32.5	0.30
2018	29.8	0.29
2019	26.5	0.26
2020	21.4	0.22
2021	22.2	0.22
2022	21.1	0.21
2023	23.3	0.22

The total annual loading of wastewater effluent TAN discharged to surface water and corresponding flow-weighted concentrations are documented in Table 7, which shows the TAN loadings separated into summer and winter periods. There was a 127% increase in summer TAN loadings from 2022 to 2023, which can be attributed to loading increase from Guelph, Kitchener, Galt, Waterloo, Dundalk, and Dunnville WWTPs. There was a 1% decrease in winter TAN loadings from 2022 to 2023. Since 2012, total TAN annual loading decreased by 92% and flow-weighted concentrations decreased by 93% .

Table 7: Wastewater effluent TAN loading and flow-weighted concentrations to the Grand River

Year	TAN summer Loading (tonne)	TAN summer Conc.* (mg/L)	TAN winter Loading (tonne)	TAN winter Conc.* (mg/L)	TAN Annual Loading (tonne)	TAN Annual Conc.* (mg/L)
2012	417	9.0	534	10.6	951	9.8
2013	346	6.7	426	7.6	773	7.2
2014	343	6.2	512	9.2	855	7.7

Year	TAN summer Loading (tonne)	TAN summer Conc.* (mg/L)	TAN winter Loading (tonne)	TAN winter Conc.* (mg/L)	TAN Annual Loading (tonne)	TAN Annual Conc.* (mg/L)
2015	206	4.2	353	7.0	560	5.6
2016	124	2.6	223	4.0	347	3.3
2017	77	1.5	182	3.3	259	2.4
2018	49	1.0	97	1.7	146	1.4
2019	31	0.6	118	2.3	149	1.5
2020	15	0.3	54	1.0	70	0.7
2021	24	0.5	44	0.9	68	0.7
2022	14	0.3	44	0.9	58	0.6
2023	31	0.6	44	0.8	75	0.7

*all concentrations are flow-weighted average concentrations

Influence of WWTPs on the Grand River

TP Loading to Lake Erie from Grand River

Figure 9 shows the estimated TP loading to Lake Erie from the Grand River at York² (shown as the blue bar on the left) and the annual TP load from WWTPs (shown as the orange bar on the right) in the Grand River watershed, from 2012 to 2023. The annual load from the Grand River to Lake Erie is highly variable because of high flows and agricultural non-point sources of phosphorus in the spring which are closely linked to climate factors such as precipitation, the timing/ volume of snow melt, etc.

² York, in Haldimand County, is the location of GRCA's southern-most flow monitoring station on the Grand River. Annual loadings from the Grand River to Lake Erie are calculated by Environment and Climate Change Canada and made available on-line through the [Environment Canada Data Catalogue](#)

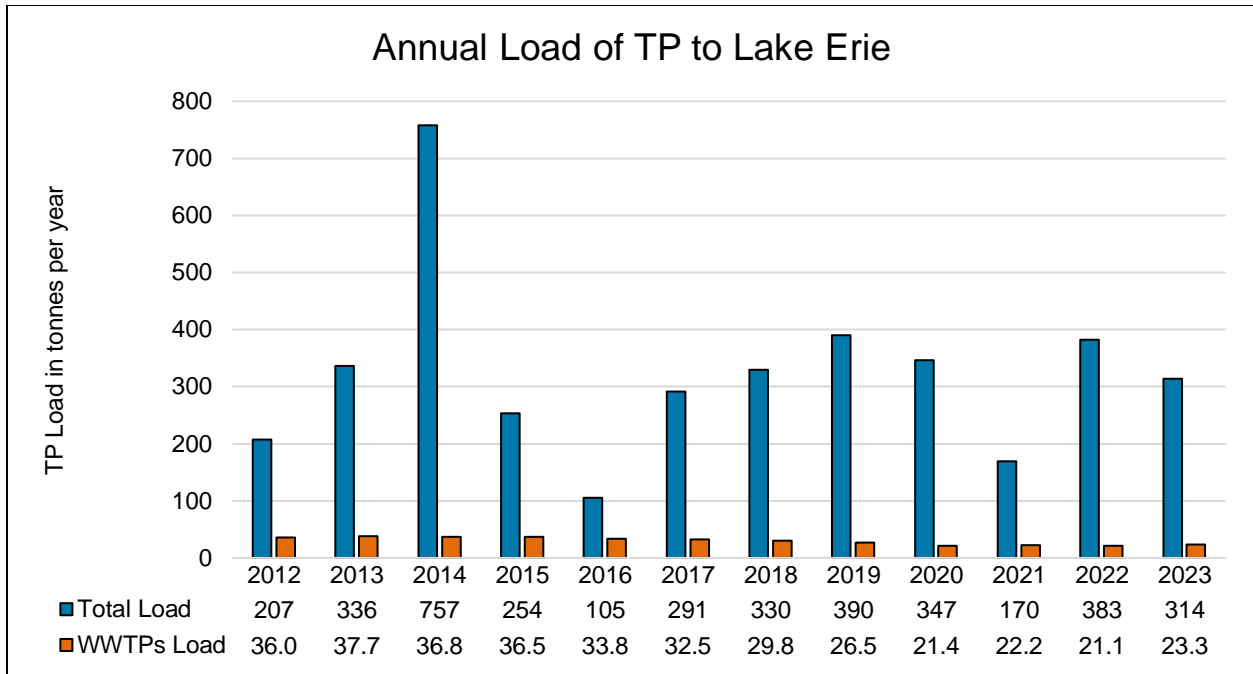


Figure 9: Annual TP Load to Lake Erie at York

Over the 12-year period from 2012 to 2023, TP loading from York averaged 324 tonnes per year and ranged between 105 tonnes per year (in 2016) to 757 tonnes per year (in 2014). The TP load from WWTPs in the watershed ranged from 21.1 to 37.7 tonnes per year and averaged 30 tonnes per year or roughly 12% of the TP load to Lake Erie from the Grand River.

Precipitation

Figure 10 shows total precipitation (i.e. snow and rain) at selected sites in the watershed. Following a significantly dry September in 2023, the watershed received slightly higher precipitation levels through the months of October and November. The driest months of the year were July and September. The watershed received around 70 percent of its long-term average rainfall in the month of November, ranging from around 54 percent in the middle portion of the watershed to around 84 percent in Bellwood area. (Taleban, 2023). Table shows the relative influence of wastewater effluent on the Grand River by comparing the total volume of treated effluent in each of the years from 2012 to 2023 to the annual average river flow at York for the same years. In addition, Table 8 also contains a statement characterizing the precipitation in each year with respect to the long-term average precipitation in the watershed.

Table 8: WWTP effluent flow as a percentage of Grand River total flow over 2012-2023 period.

Year	Precipitation Characterization*	% Annual Average Flow	% August Average Flow
2012	Low end of typical	6.8%	13.9%
2013	Higher than typical in some areas	3.1%	5.4%
2014	Long-term average	2.6%	9.5%
2015	Low end of typical	5.0%	11.5%
2016	Long-term average	4.7%	9.0%
2017	Higher than typical	3.5%	7.3%
2018	Long-term average	3.6%	8.7%
2019	Higher than typical	3.6%	10.3%
2020	Long-term average	4.7%	11.7%
2021	Long-term average	5.1%	12.6%
2022	Low end of typical	5.5%	14.5%
2023	High end of typical	5.0%	7.1%
Overall Average		4.4%	10.0%

* (Shifflett, 2012) (Shifflett, 2013) (Shifflett, 2014) (Shifflett, 2016) (Shifflett, 2017) (Shifflett, 2018) (Shifflett, 2019) (Shifflett, 2020) (Shifflett, 2021) (Shifflet, 2022) (Taleban, 2023)

The volume of treated effluent ranges from 2.6% to 6.8% of the total river flow on an annual average basis. By comparison, based on low-flow conditions observed in the month of August, under summer low-flow, the proportion of treated effluent ranges more widely from 5.4% to 14.5% of the river flow. This shows that the influence of WWTP flow on the river varies from year to year depending on precipitation.

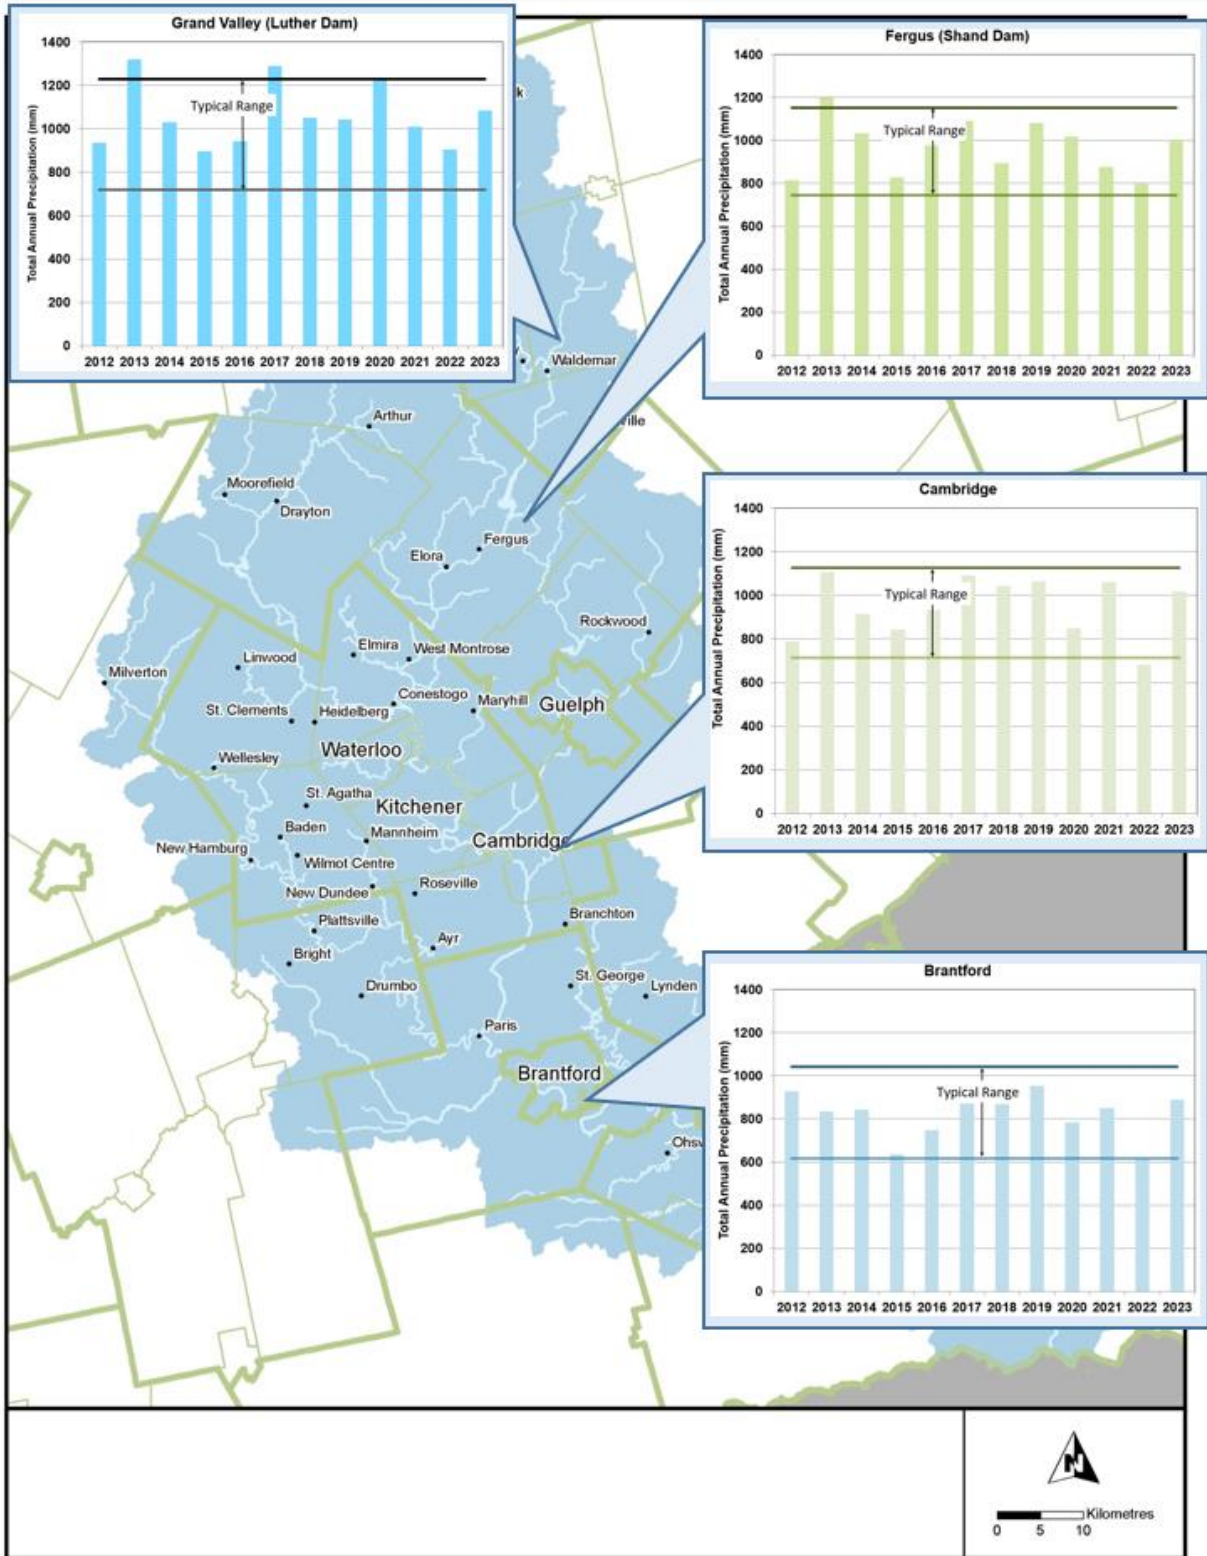


Figure 10: Total annual precipitation (in mm) at selected locations across the watershed. Typical range is based on 5th and 95th percentile of historical observations over the past 50 years.

Recent studies

Since 2007, the Region of Waterloo has carried out a comprehensive surface water quality monitoring program upstream and downstream of its WWTPs. The purpose of the program is to determine what impacts, if any, effluent discharges are having on the Grand River and its tributaries and to document how those impacts may be changing with time. This monitoring program has shown that some Regional WWTPs, especially the larger ones, can have observable impacts on receiver water quality, particularly in the summer and fall seasons when river flows are low. The data collected in 2023 illustrate that the Region's largest plants had no statistically significant increase on TP and TAN concentrations, however during summer low-flow conditions the data showed exceedance of TP Provincial Water Quality Objectives (PWQO) downstream of Kitchener and Waterloo treatment plants (LGL Limited, 2024). Based on the 2024 Surface Water Quality Study developed by the LGL, water quality has improved downstream of Region of Waterloo wastewater treatment plants compared to previous years, although the reported loading for TP and TAN from the major plants increased from 2022 to 2023. Impact on the receiving water concentrations may have been a result of increased river flow and time of the sampling.

Bypasses and Overflows

Bypasses are a diversion of sewage around one or more treatment processes. The diverted sewage is combined with treated effluent at the point of discharge. Overflows are discharges to the environment from the WWTP at a location other than the effluent discharge point. Bypasses and overflows can be caused by equipment failure, power outage, weather-related events, etc. and can be classified as low, moderate, or high according to the level of risk to downstream users. In the Grand River watershed, one of the most sensitive downstream uses is the use of river water as a source for drinking water. The risk categories were developed based on the professional judgment of the Grand River Municipal Water Managers Working Group (Grand River Municipal Water Managers Working Group, 2009). For example, a bypass that has received secondary treatment and disinfection is considered low risk, whereas a bypass that has received secondary treatment without disinfection is classed as moderate risk. A high-risk bypass or overflow, for example, occurs when raw sewage is discharged to the environment without disinfection. Figure 11 shows the number of low, moderate and high-risk bypasses from WWTPs in the Grand River watershed from 2013-2023. The number of low-risk bypasses increased from 13 in 2022 to 49 in 2023. There were no moderate risk bypasses recorded in 2022, 14 moderate risk bypasses were recorded in 2023. The number of high-risk bypasses decreased from 8 in 2022 to 3 in 2023. Figure 12 shows the total volume of bypasses in 2023.

Most of the bypasses in 2023 were related to weather conditions generating high peak day flows to the WWTP.

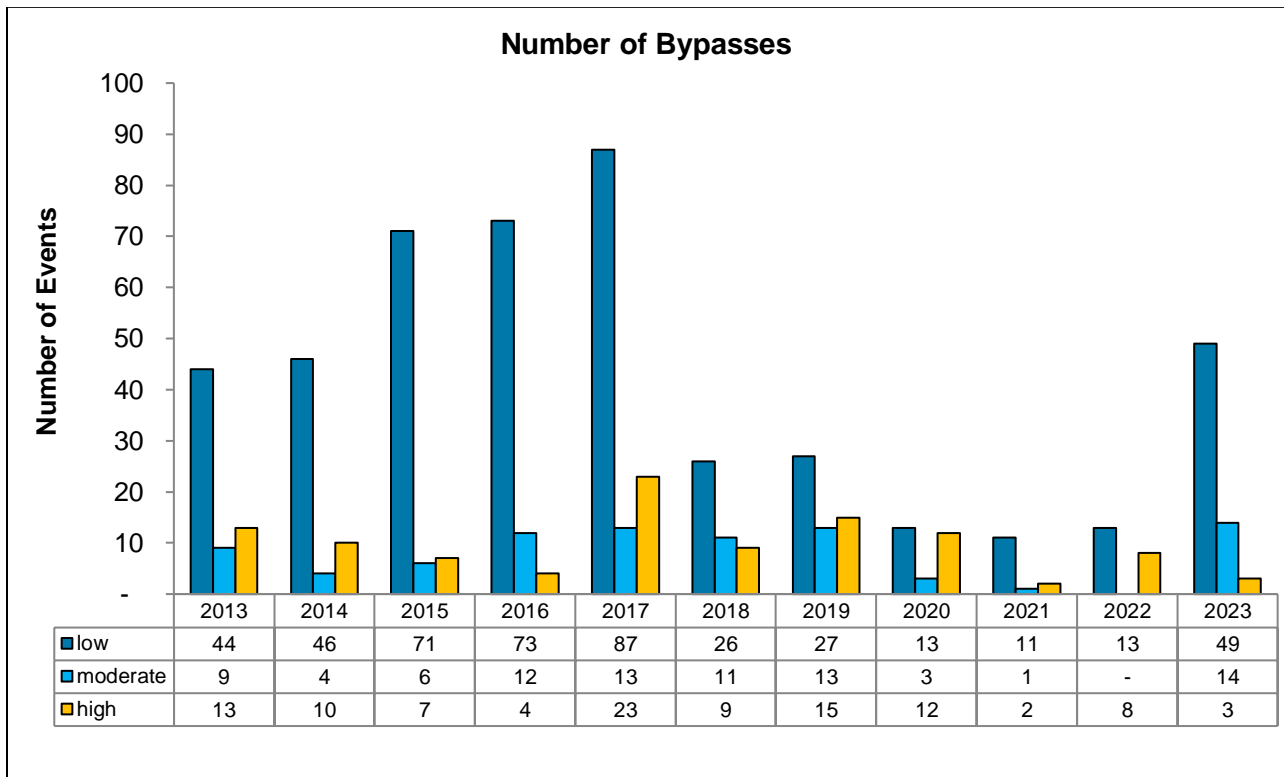


Figure 11: Number of low, moderate, and high-risk bypasses from 2013-2023

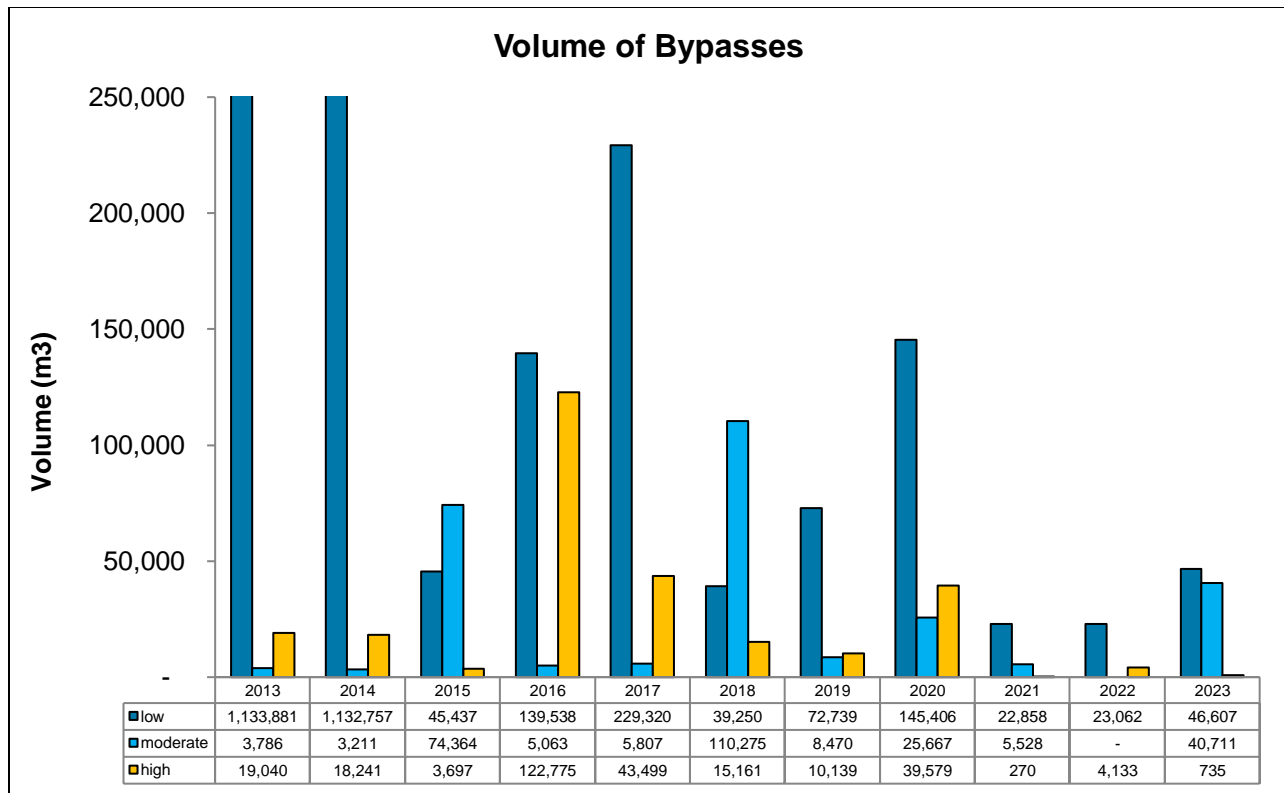


Figure 12: Volume of low, moderate, and high-risk bypasses from 2013-2023

Data Integrity Checks

Several data integrity checks were used to determine if the monitoring conducted at the WWTP is truly representative of plant performance. A sludge accountability analysis for mechanical activated sludge plants compares the amount of sludge reported to the amount of sludge projected based on plant loadings and removals, on an annual basis. The reported sludge includes sludge intentionally wasted by the operator to control the biological process and unintentional wasting (i.e., solids lost from the plant in effluent TSS). Projected sludge can include an estimate of primary sludge, biological sludge generated by the conversion of organics to biomass, and chemical sludge (i.e., solids produced as a result of coagulant addition). The formula to calculate sludge accountability is as follows:

$$\frac{\text{projected sludge} - \text{reported sludge}}{\text{projected sludge}} * 100\%$$

If the result is within a range of $\pm 15\%$ the sludge accountability is considered to “close” (EPA, 1989). If the value is outside of this range, then the monitoring may not be truly representative of plant loading or performance. In the case of sludge accountability that does

not close, further investigation is warranted to review sample frequency, sampling techniques, analytical methods, flow measurement accuracy, etc.

Common sources of sludge accountability analysis discrepancy include:

- Non-representative sampling (poor sampling techniques or analytical procedures, inadequate sampling frequency, a sampling location which is not representative, etc.),
- Lack of flow measurement on some process streams or inaccurate flow measurement, and
- Neglecting to consider all inputs and outputs (e.g., no measurements on return streams such as filter backwash or digester decant, etc.).

Table 9 shows the results for 22 plants in the watershed that conducted sludge accountability in 2023. For 2023, Kitchener, Guelph, Waterloo, Brantford, Galt, Preston, Hespeler, Elmira, Ayr, Wellesley, Cayuga, Drumbo, and Conestogo WWTPs have a sludge accountability analysis that closed within $\pm 15\%$. Sludge accountability results for all plants, including reported and projected sludge values can be found in Appendix 1: Sludge Accountability and Water Balance Summary. The order of the WWTPs presented in the Table 10 is based on the 2023 average daily flow (ADF).

Table 9: Summary of 2019 to 2023 Sludge Accountability Analyses

WWTP	2019	2020	2021	2022	2023
Kitchener	-8.3%	-14.2%	8.3%	-3.1%	-1.0%
Guelph	-6.9%	-13.9%	-6.3%	9.6%	10.0%
Waterloo	18.9%	7.5%	14.9%	-3.6%	-10.7%
Brantford	-8.3%	6.3%	-3.8%	13.5%	6.8%
Galt	-3.1%	14.8%	25.7%	4.7%	-14.5%
Preston	8.2%	-10.7%	7.8%	-7.3%	5.8%
Hespeler	-1.9%	-24.4%	1.7%	9.9%	-2.5%
Paris	-36.2%	-10.3%	-23.1%	13.5%	-77.5%
Fergus	Not Reported	Not Reported	-21.6%	Not Reported	32.3%
Dunnville	-16.7%	15.7%	0.6%	-32.2%	-36.8%
Elmira	-8.0%	-27.7%	-19.1%	-35.3%	4.6%
New Hamburg	-167.6%	-100.0%	-47.6%	-17.0%	17.3%
Caledonia	31.1%	7.6%	21.6%	10.5%	18.5%
Elora	Not Reported	Not Reported	-43.1%	Not Reported	27.7%
Ayr	-7.7%	-3.4%	-9.9%	19.6%	14.1%
Arthur	Not Reported	Not Reported	Not Reported	-27.3%	Not Reported
Grand Valley	Not Reported	Not Reported	Not Reported	-4.0%	Not Reported
St. Jacobs	1.2%	-5.4%	26.3%	12.2%	-20.7%
Wellesley	9.1%	15.4%	15.9%	12.2%	8.7%
Cayuga	-31.5%	-32.2%	-32.2%	-42.1%	-9.0%
St. George	-410.9%	Not Reported	-36.0%	-48.3%	-79.4%
Drumbo	7.3%	-11.0%	-4.3%	11.6%	11.8%
Alt Heidelberg	-125.0%	-119.3%	-51.5%	-83.0%	-82.0%
Conestogo	19.9%	53.2%	11.0%	14.7%	-6.6%

Under the Grand River WWOP, a water balance analysis was developed for lagoon systems as a performance check since sludge accountability cannot be performed. A water balance analysis compares the difference between the measured net precipitation and the projected net precipitation and is reported as a percentage of influent flow. The measured net precipitation is based on the net precipitation and the lagoon surface area. Projected net precipitation is determined using lagoon level measurements, total influent sewage and effluent volume on an annual basis. The formula to calculate a water balance is as follows:

$$\frac{\text{reported net precipitation} - \text{projected net precipitation}}{\text{influent flow}} * 100\%$$

If the result is within a range of ±minus 15% , the water balance is considered to “close” (EPA, 1989). If the value is outside of this range, then the flow measuring devices or lagoon level measurements may not be accurate. Further investigation is warranted to review all flow measuring devices and confirm their accuracy.

Table 10 shows the results for the lagoons that conducted a water balance analysis for 2019 - 2023. A detailed summary of water balance results is located in Appendix 1: Sludge Accountability and Water Balance Summary. Sources of discrepancy in the calculation may include the following: inaccurate flow measurement, inaccurate surface area information, uncertainties in precipitation and/or evaporation data and error in lagoon storage measurements.

Table 10: Summary of 2019-2023 Water Balance analyses of lagoons

Lagoon	2019	2020	2021	2022	2023
Dundalk	13.8%	10.4%	6.4%	15.6%	17.0%
Drayton	Not Reported				
Plattsville	2.6%	-6.5%	13.8%	11.2%	0.0%
Cainsville	77.0%	66.9%	25.9%	85.2%	83.2%

WASTEWATER TREATMENT PLANT LOADING SUMMARY

Influent flow

Figure 13 shows a summary of the average daily flow (ADF) to each plant for 2019 to 2023 compared to the Nominal Design Flow (NDF) of the plant as stated in the plant’s ECA (shown in

grey). Figure 13 shows three vertical scales since the nominal design of the WWTPs in the watershed vary by orders of magnitude and range from 130 m³/d to 122,745 m³/d. Figure 14 shows the ADF as a percentage of the NDF. In 2023, Cainsville lagoon experienced an ADF that was higher than the NDF. Since 2012 four plants experienced ADFs higher than their NDF: Arthur (2012 to 2014 and 2017), Drumbo (2013 and 2014), Cainsville (2014 and 2023), and Wellesley (2019). The NDF for the Drumbo plant was re-rated in 2015 from 273 to 300 m³/d. The NDF for the Arthur plant was re-rated in 2020 from 1,465 to 1,860 m³/d.

Another way to look at influent flow is to normalize it based on the serviced population and express it as per capita flow. Per capita wastewater flows vary from location-to-location, but typical values used in the CCP are from 350 to 500 L/person/d (EPA, 1989). Figure 15 shows per capita flows for WWTPs in the watershed between 2019 and 2023. From this figure, plants in the Grand River watershed were generally at or below the low end of the typical range. The watershed median for 2023 was 296 L/person/day, a 6% increase from the 2022 median of 280 L/person/day and 5% decrease from the 2012 median of 310 L/person/day.

Plants experience higher than typical per capita flows for various reasons. For example, the Cainsville WWTP services primarily industrial users and therefore has a higher per capita flow than a typical domestic sewage system. As such Cainsville WWTP is not displayed in the per capita and ratio figures. Other WWTPs, such as Arthur, St. Jacobs, and Dundalk, may be subject to high inflow/ infiltration (I/I).

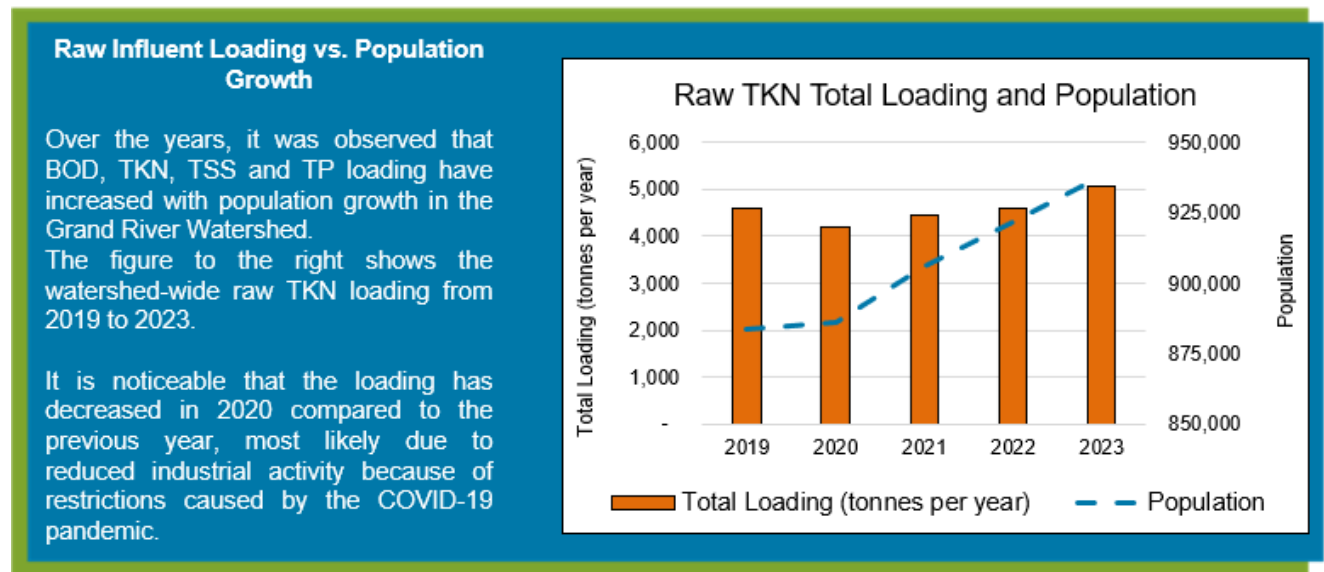


Figure 16 shows the ratio of peak day flow to ADF, which is another indicator of significant I/I. The ratio of peak day flow to ADF varies from year-to-year depending on climate factors such as heavy rainfall or snowmelt events. The median ratio for plants across the watershed was 3.0 in 2023. Most plants were within the typical range of 2.5-4.0 or less. Several plants are known to experience higher I/I (such as the Dundalk, Mapleton, or Caledonia WWTP) and this is reflected in Figure 16.

Year-to-year variability in per capita flow is largely due to differences in inflow and infiltration related to precipitation. On a watershed -basis the highest per capita flows were 351 L/d per person in 2013 which was a “wet” year. The smallest per capita flows were 280 L/d per person in 2022.

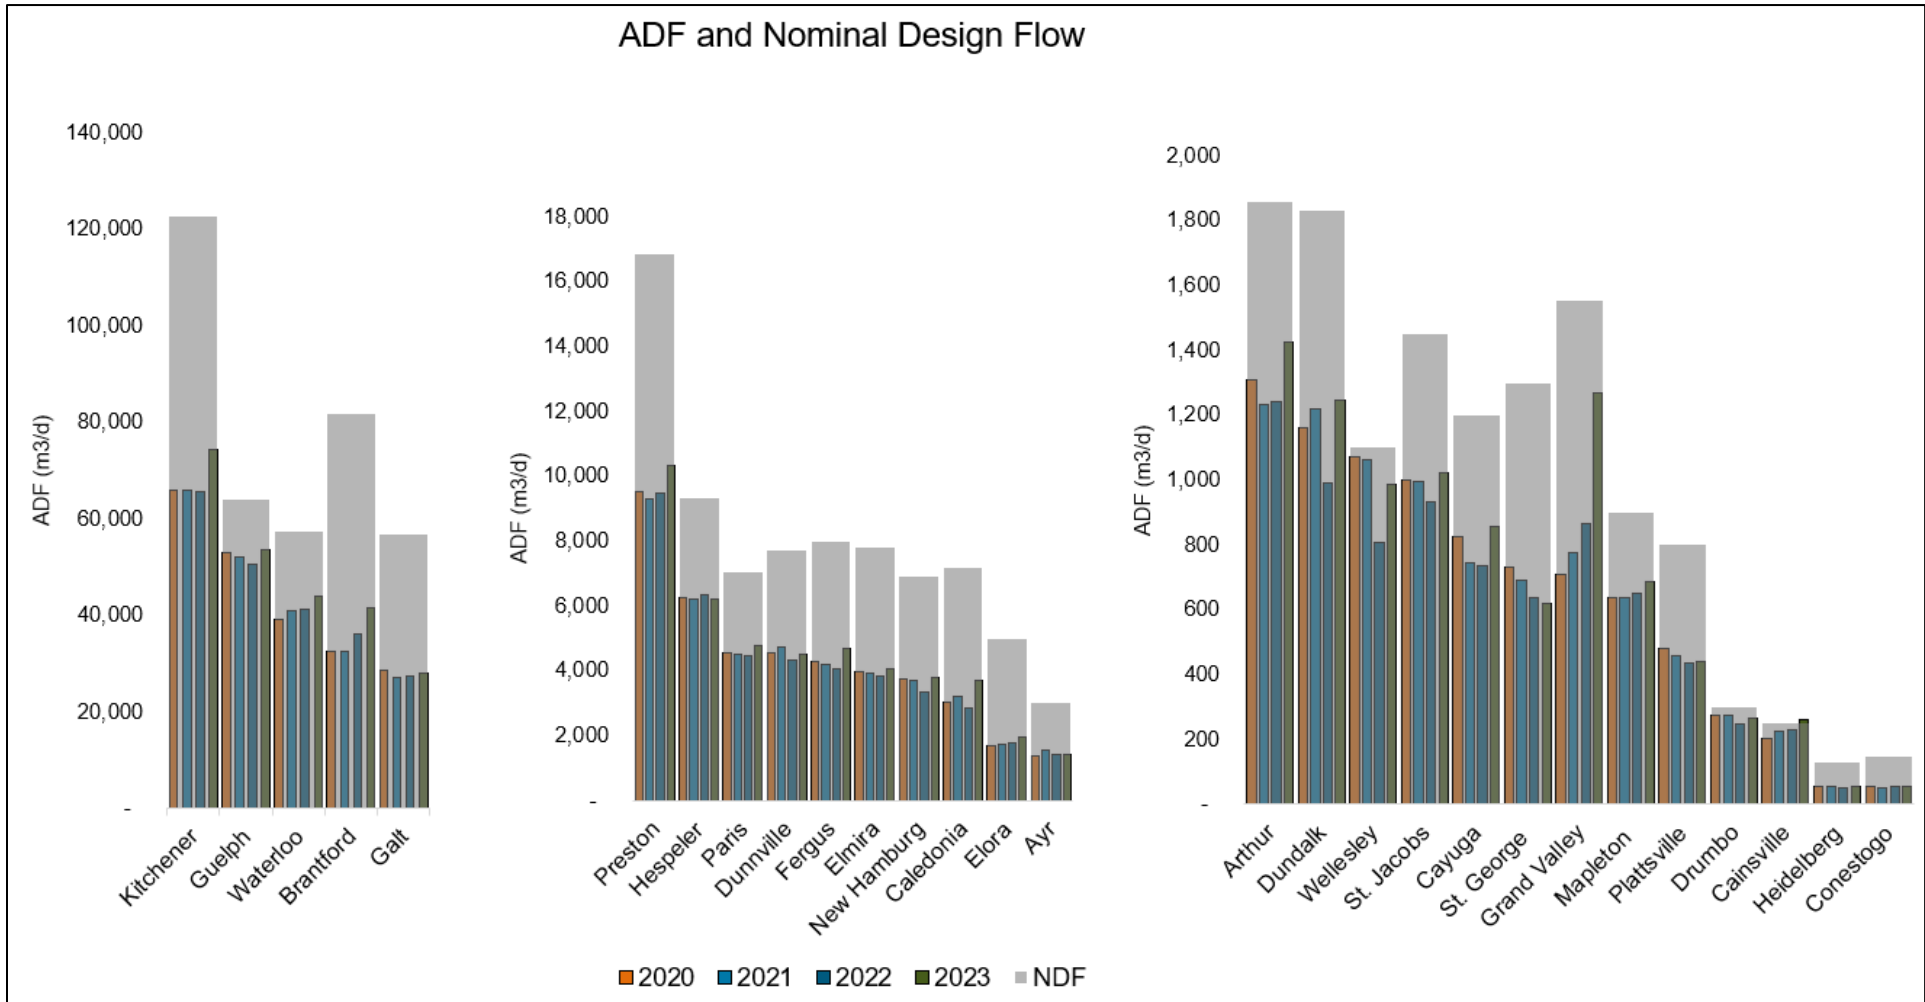


Figure 13: ADF and Nominal Design Flow of watershed WWTPs

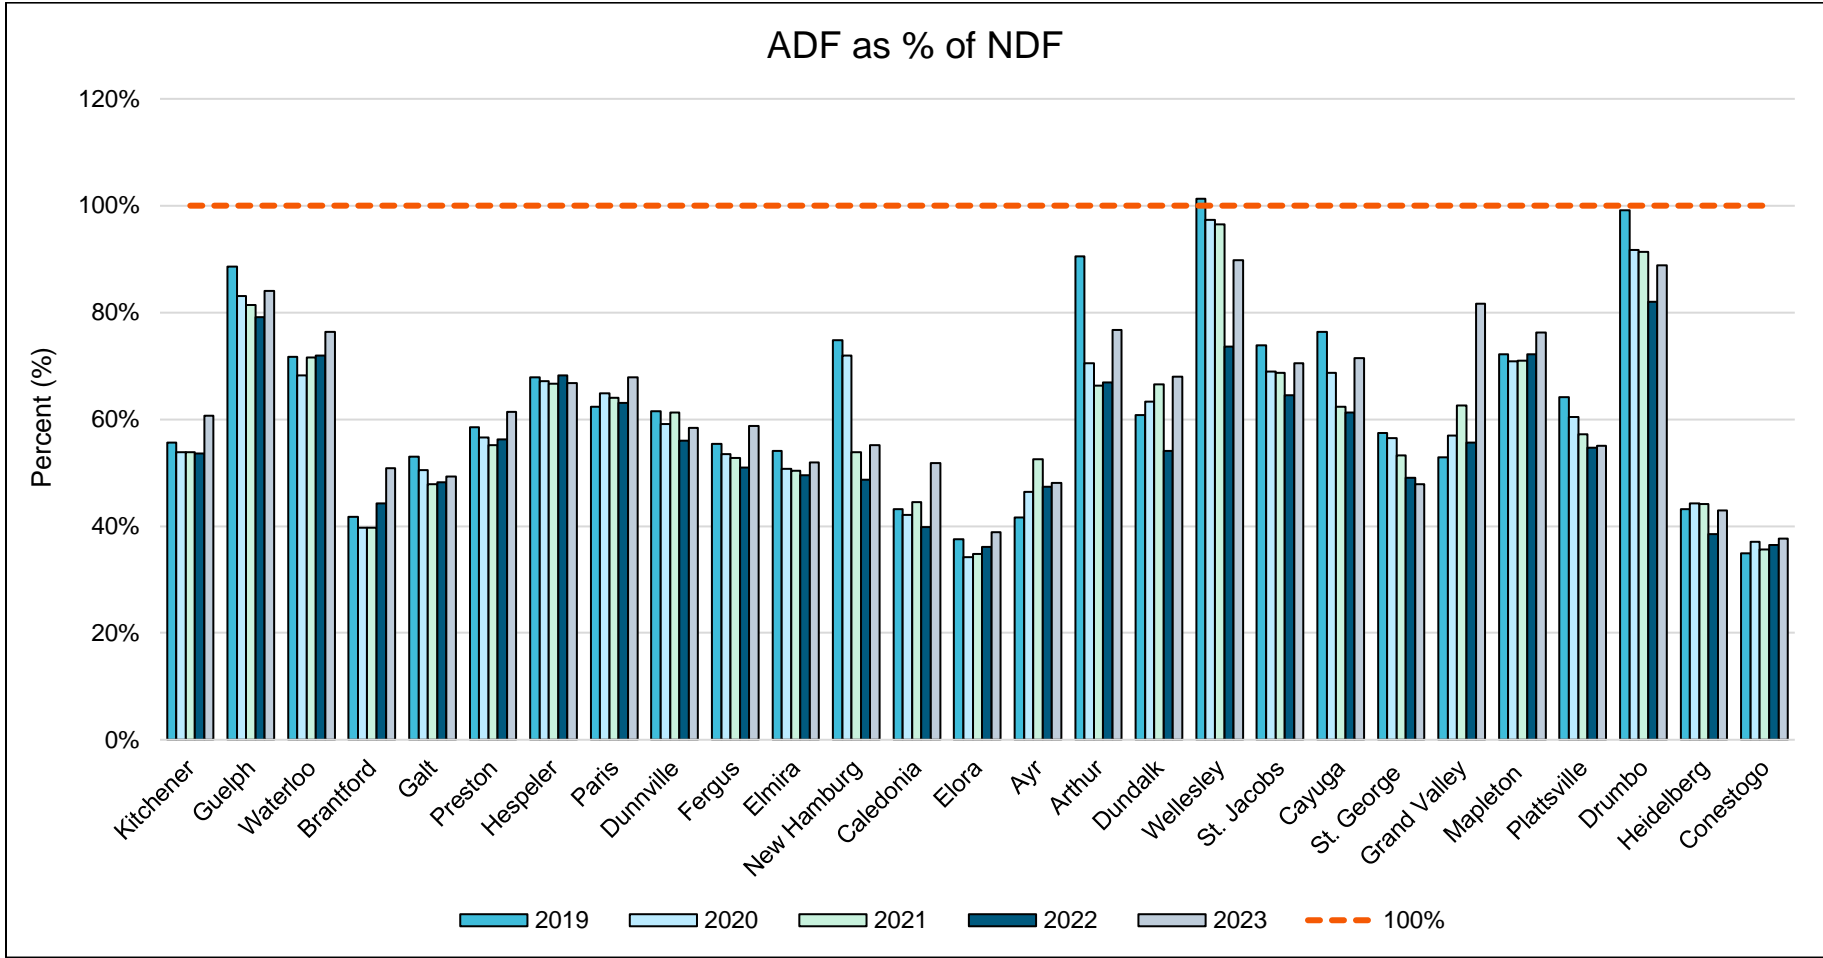


Figure 14: Annual average flow as a percentage of rated plant capacity

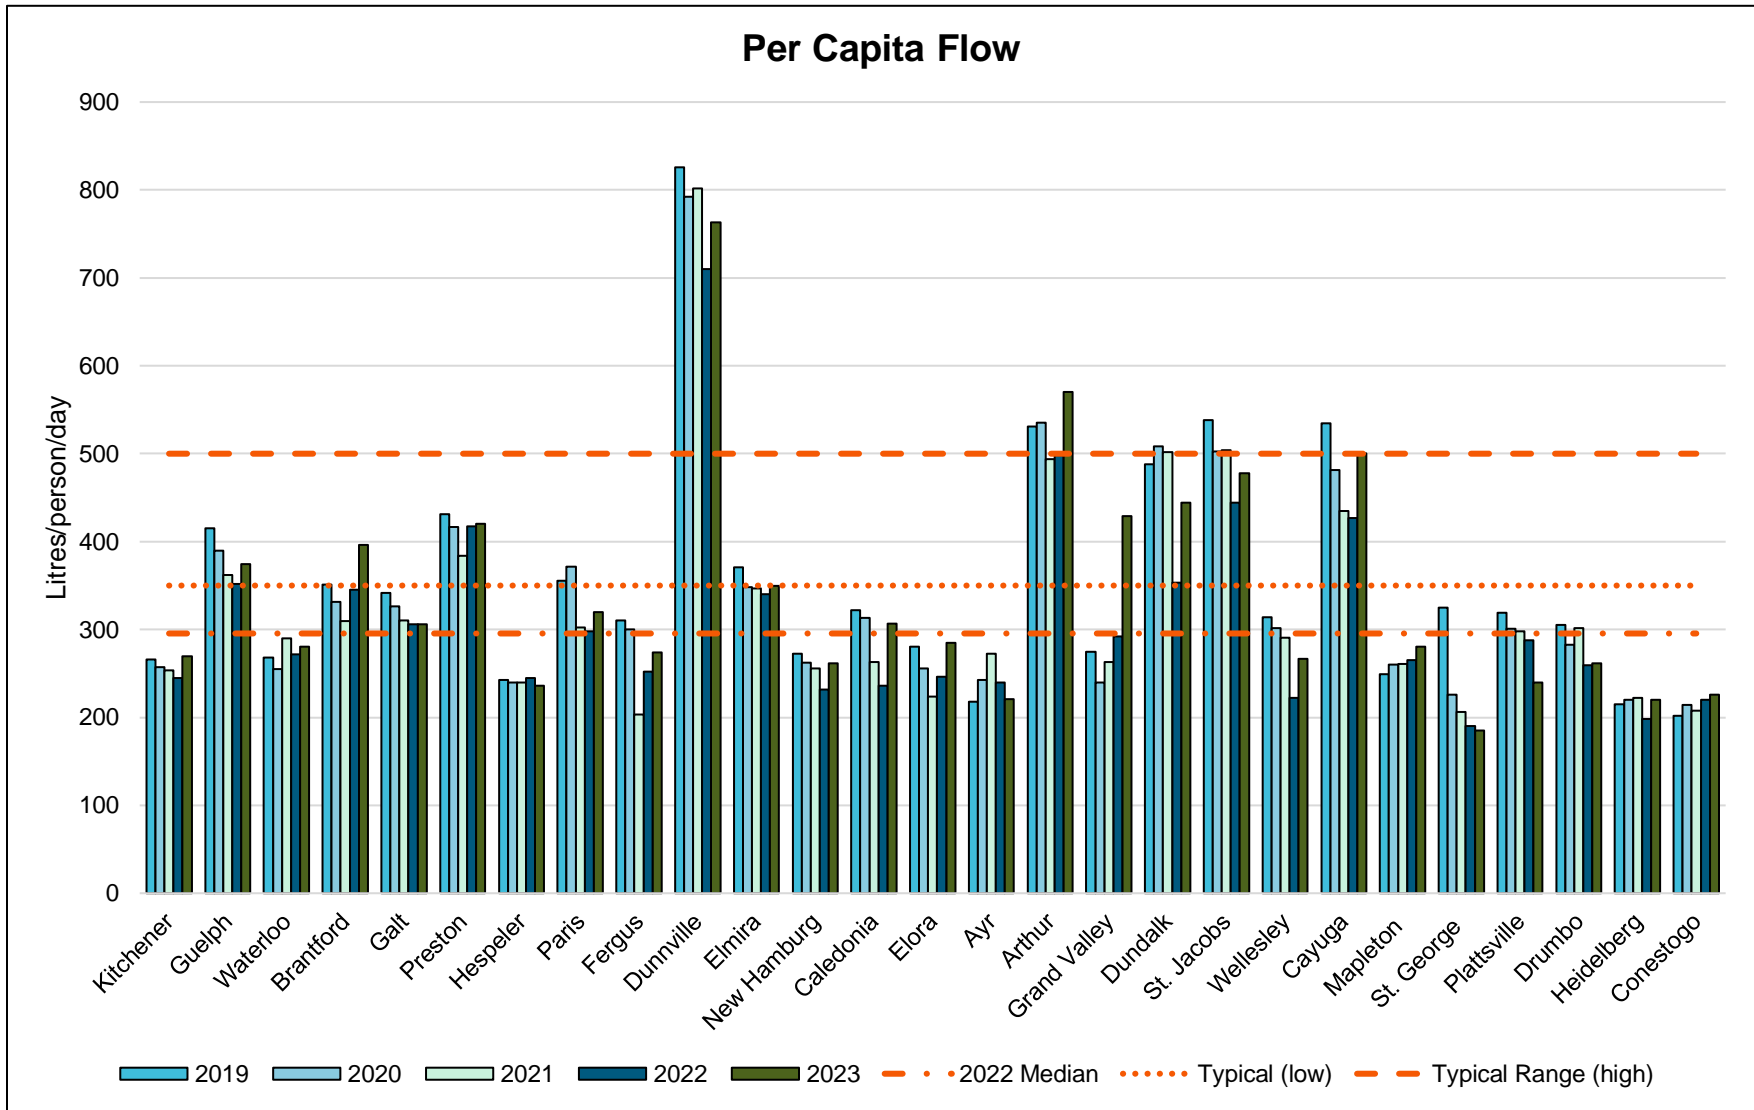


Figure 15: Per capita influent flow

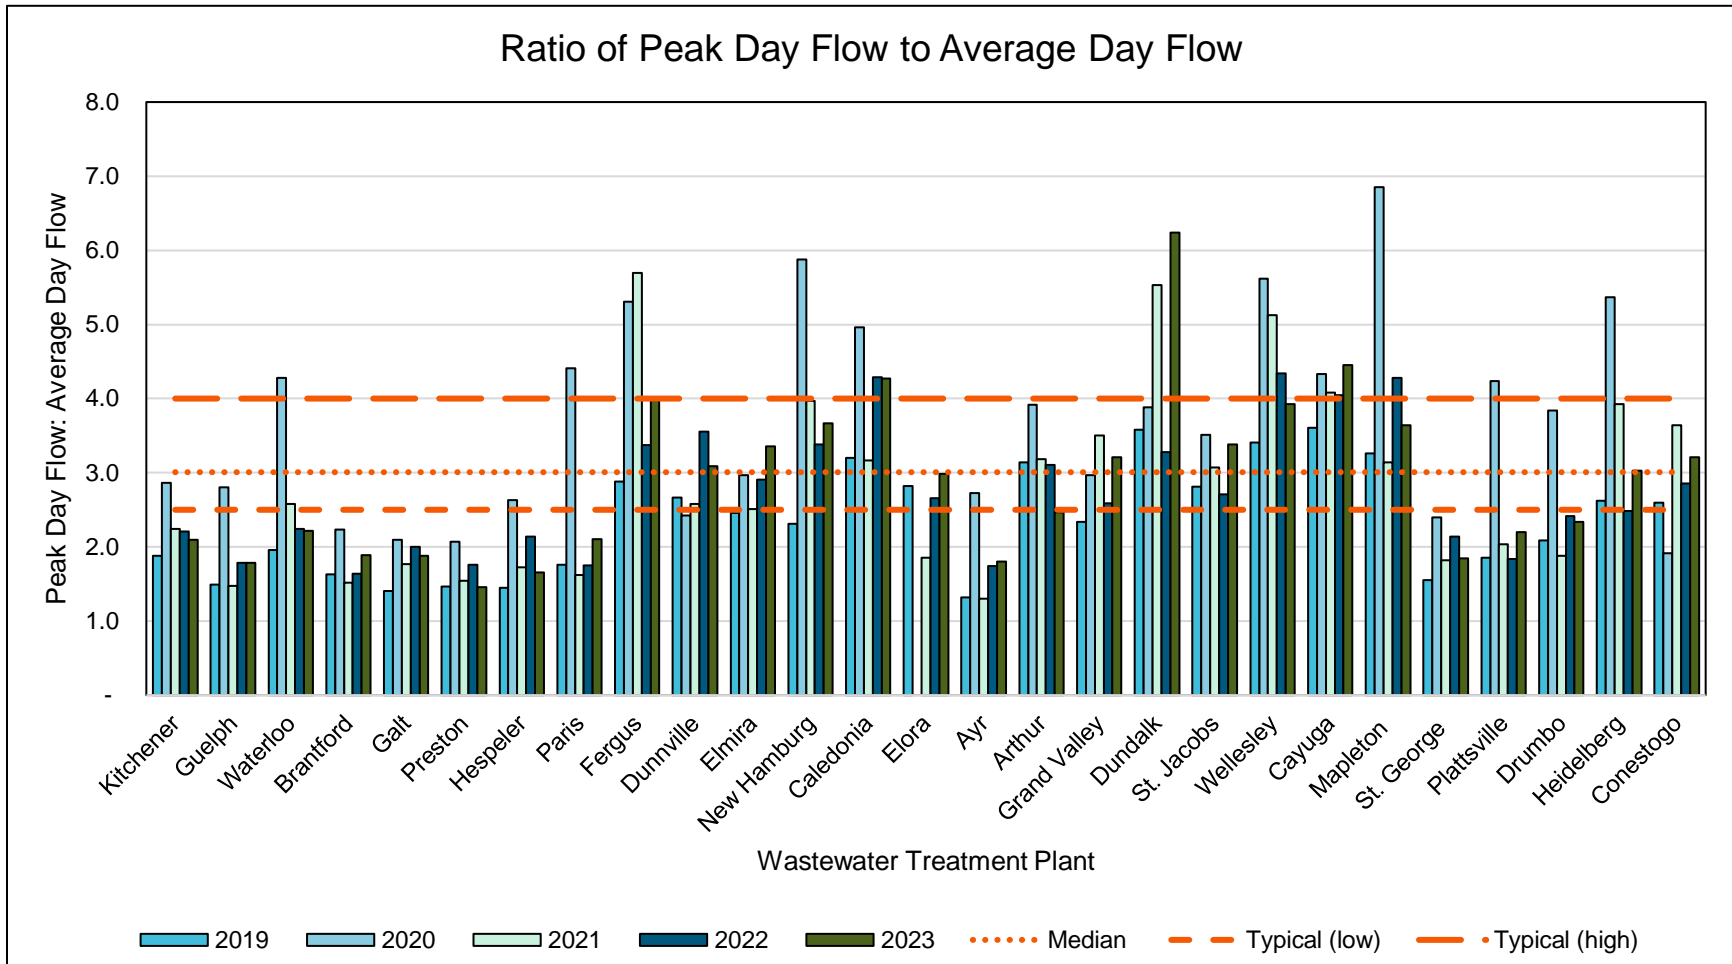


Figure 16: Ratio of peak day flow to annual average flow

Raw Influent Loads

Characterization of raw wastewater is important to ensure effective wastewater treatment, assist with future planning, and identify any issues or changes occurring in the collection system. The loading of raw influent TBOD, TSS and TKN can be calculated by multiplying raw influent concentrations by flow. These loads can be expressed on a per capita basis and compared to values typical of domestic sewage.

TBOD Loading

In 2023, all 28 plants that reported data measured raw influent TBOD. Table 11 summarizes the results of both cBOD and TBOD as reported by plants in the Grand River watershed between 2016 and 2023:

Table 11: Annual average raw influent cBOD and TBOD concentrations reported by Grand River watershed plants in 2016-2023.

Year	No. of plants reporting cBOD	No. of plants reporting TBOD	No. of plants reporting Both cBOD & TBOD	Median (mg/L) cBOD	Median (mg/L) TBOD	Range (mg/L) cBOD	Range (mg/L) TBOD
2016	18	21	11	195	208	127-389	142-411
2017	18	26	16	177	194	98-411	108-421
2018	18	26	16	182	197	94-296	112-304
2019	18	24	16	177	211	92-269	107-311
2020	17	23	14	192	203	81-322	88-396
2021	21	28	18	199	208	89-360	134-378
2022	19	28	19	214	251	113-366	134-393
2023	19	28	19	219	221	93-364	139-417

Albertson (1995) has documented that the cBOD test underestimates the strength of raw wastewater by 20-40% (Albertson, 1995). In 2023, 19 of 28 reporting plants in the watershed measured both cBOD and TBOD. The average TBOD:cBOD ratio among these plants is 1.12. A factor of 1.2 was used for estimation in previous years.

Figure 17 shows estimated per capita TBOD loads for plants in the Grand River watershed. A typical value for domestic wastewater is 80 g/person/d (EPA, 1989). The reported 2023 median is 68.8 g/person/d, slightly higher than the 2022 median of 66.9 g/person/d.

Per capita TBOD loads that are much higher or much lower than the typical value should be further investigated to see if there is a reasonable explanation for the discrepancy. In some cases, industrial contributions may result in elevated per capita TBOD loads. However, atypical TBOD loads may also be related to inadequate sampling frequency, non-representative sampling, errors in flow metering or population estimates, etc.

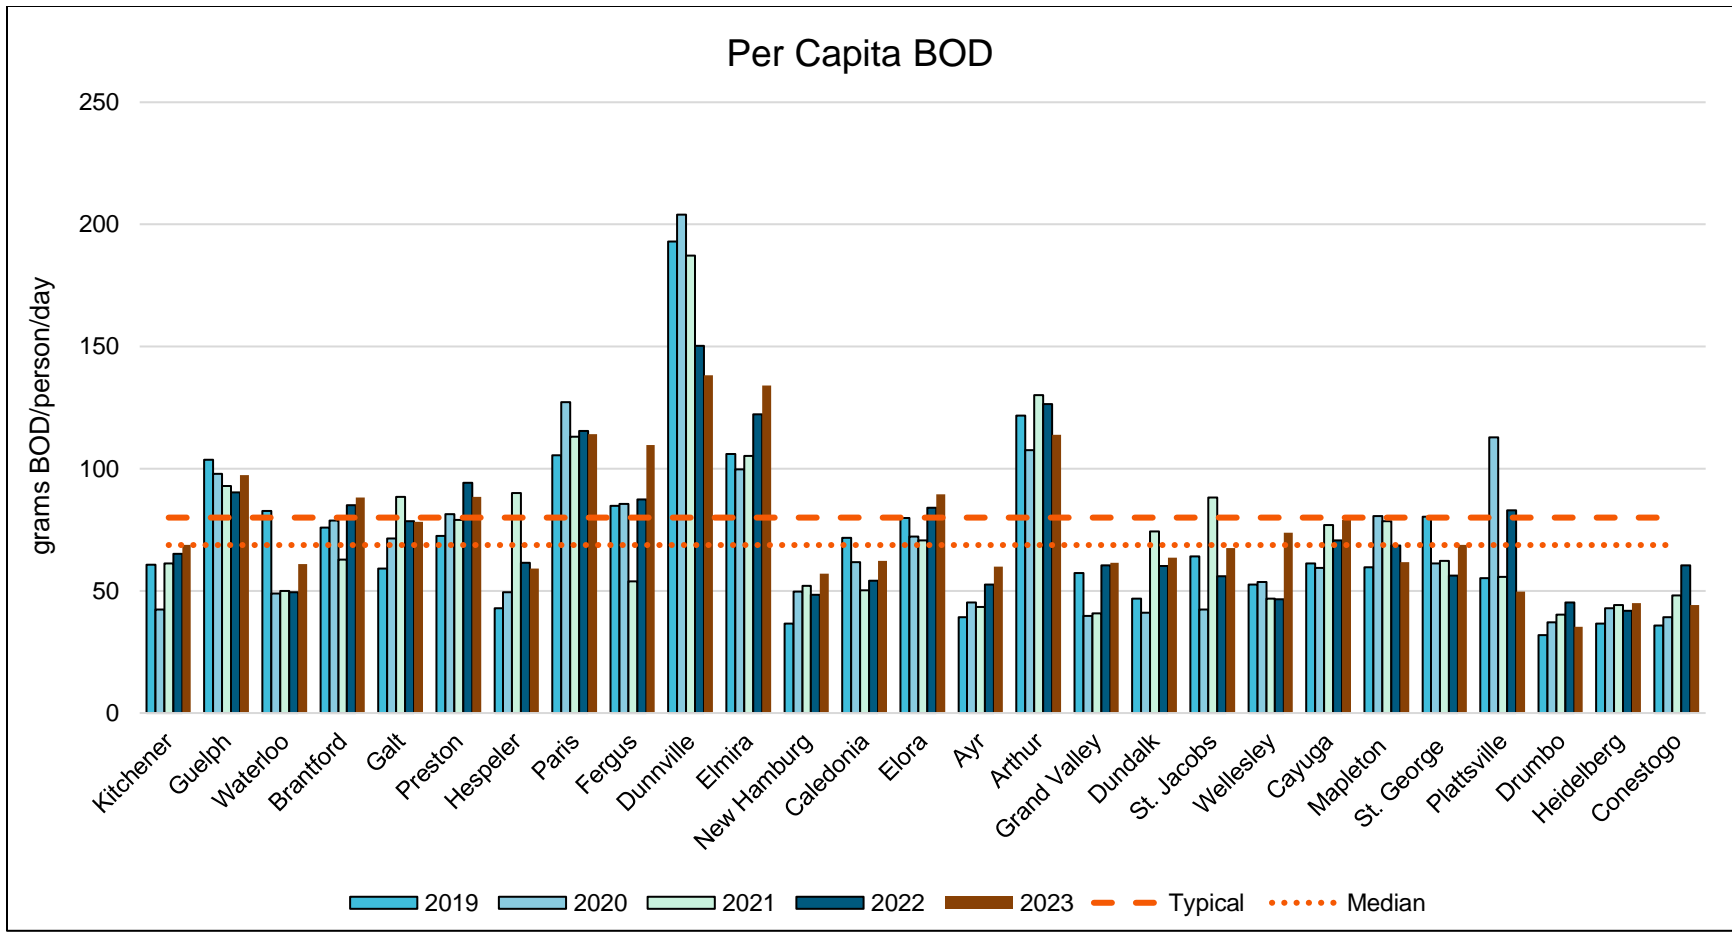


Figure 17: Per Capita TBOD Load

TSS Loading

TSS loads in raw influent for 2019 to 2023 are summarized in Figure 18. The 2023 watershed median was 85 g/person/d, which is less than the typical value of 90 g/person/d (EPA, 1989). This value was 74 g/person/d in 2020, when the industrial activity was minimal as a result of restrictions caused by the COVID-19 pandemic. Where the loads are significantly less than typical, it brings into question the adequacy of raw influent sampling to accurately characterize the influent. Higher than expected loads may be attributed to industrial inputs and/or internal recycle streams.

TKN Loading

Figure 19 shows per capita TKN loads to plants in the watershed. The watershed median was 13.3 g/person/d for 2023 which is slightly higher than the typical value of 13 g/person/d (WEAO, 2010). Several plants (such as Dundalk, Elmira, Galt, and Preston) reported TKN loads that are higher than expected and in most cases the per capita TSS and/or estimated TBOD loads were also high. A small number of plants had TKN, TSS and TBOD loads that were less than typical. Further investigation, such as characterization of raw influent and recycle streams and review of population estimates, may be helpful when per capita loadings are outside the typical range.

TP Loading

Figure 20 shows the TP loads in the raw influent for 2019 to 2023. The watershed median for 2023 was 1.7 g/person/d. This is less than the typical value of 2.1 g/person/d.

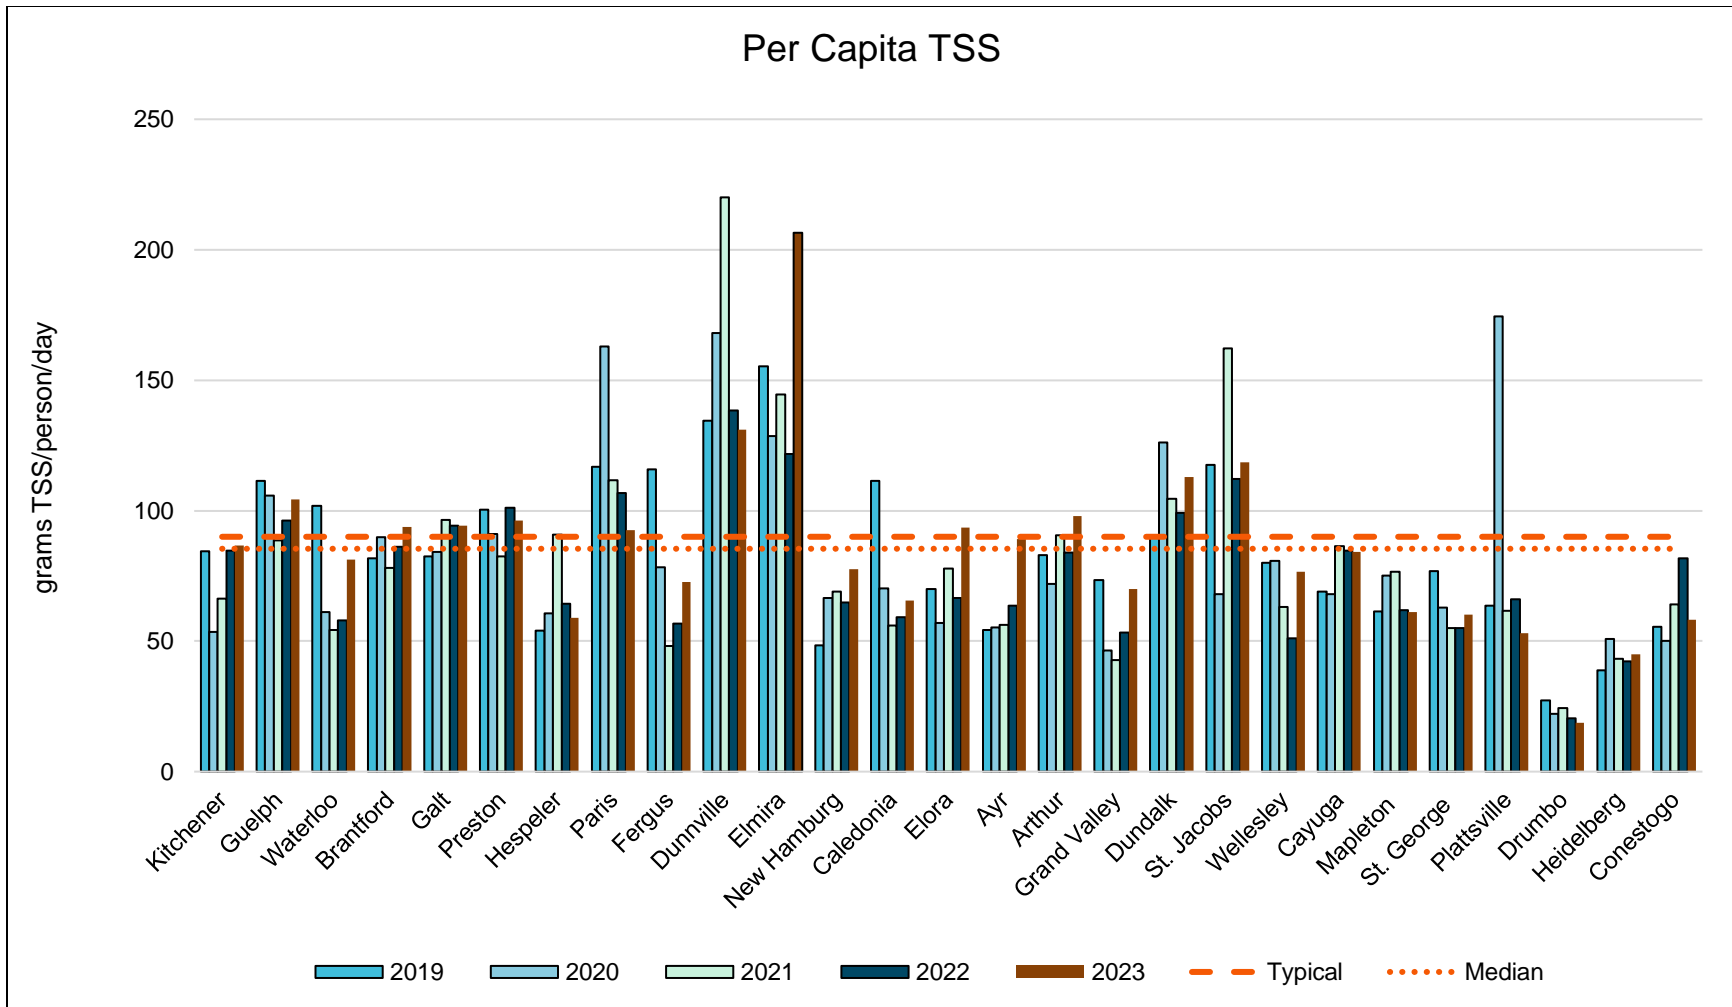


Figure 18: Per Capita TSS Load

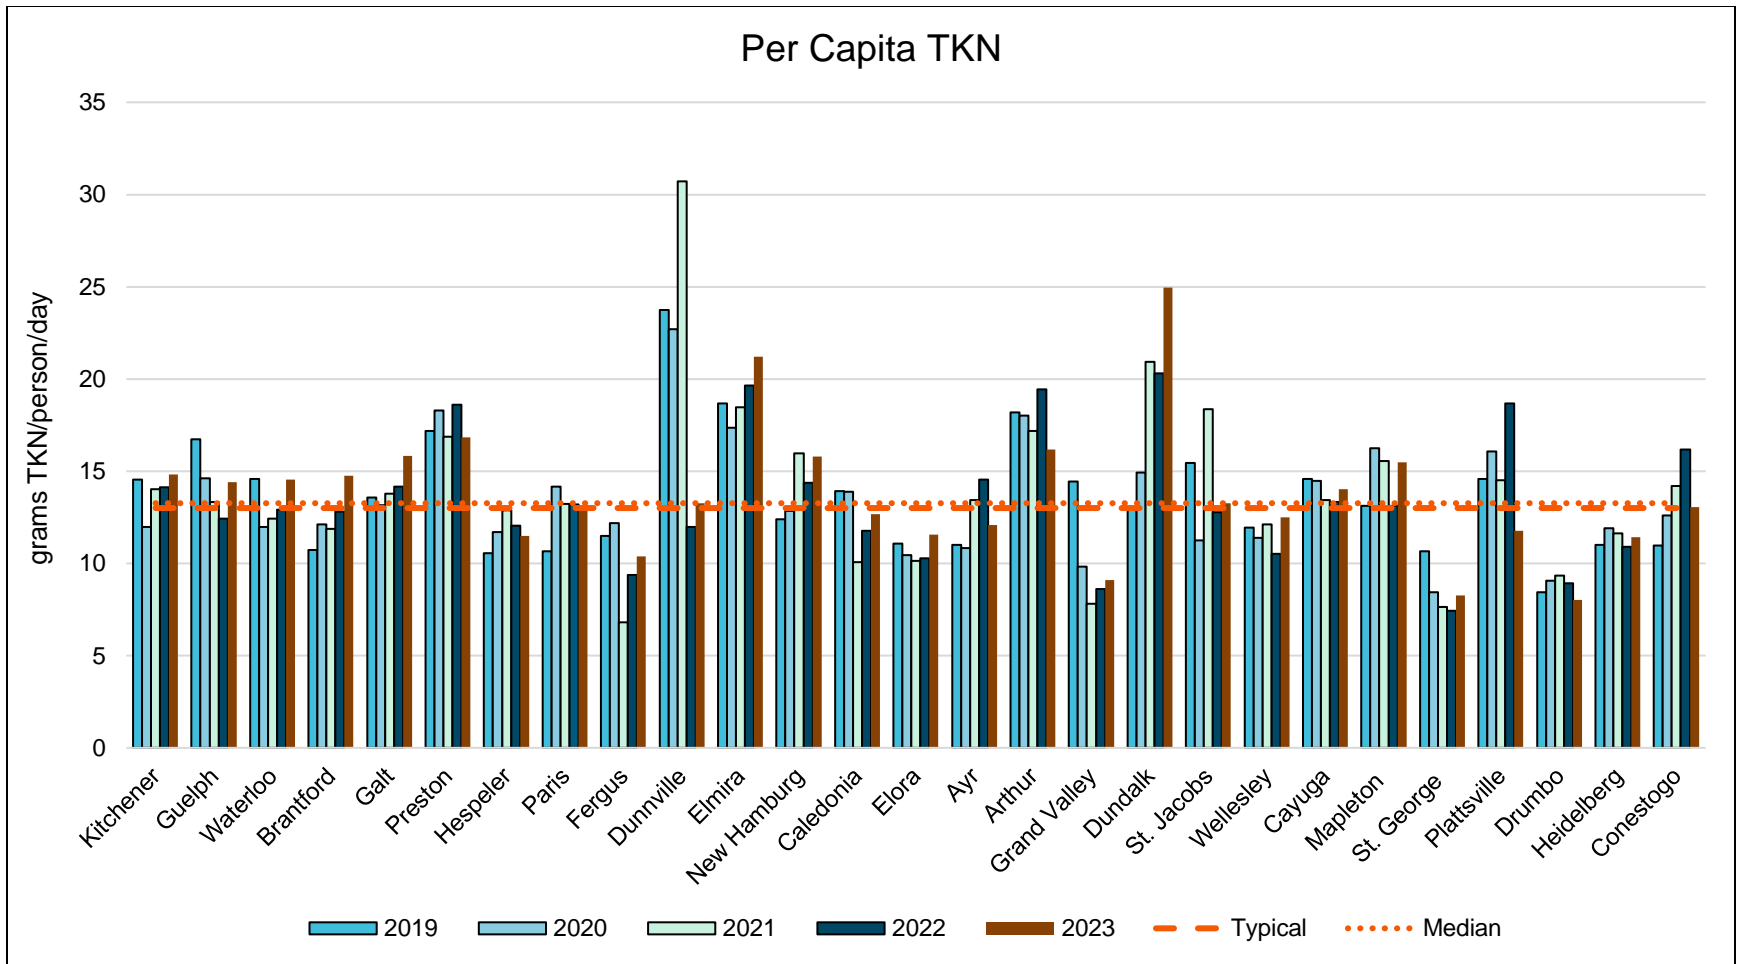


Figure 19: Per Capita TKN Load

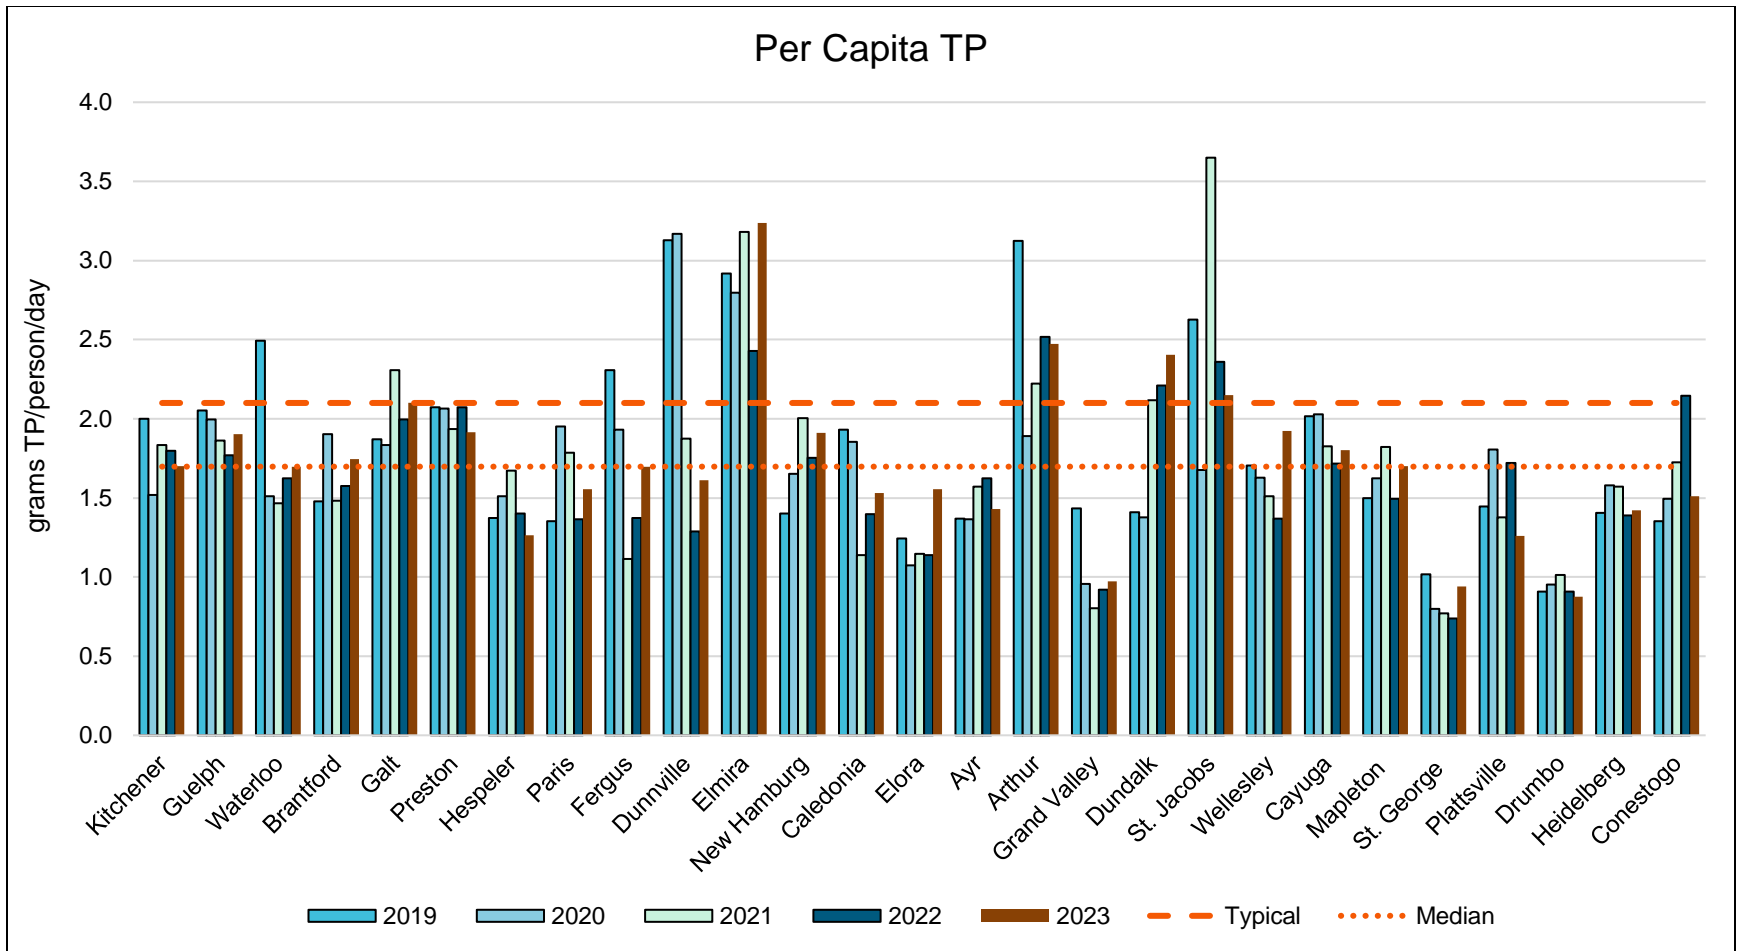


Figure 20: Per Capita TP Load

Ratios

Calculating raw influent ratios for TSS:TBOD and TKN:TBOD can be used to provide insight on what is entering the plant from the collection system as well as any potential sampling problems. Figure 21 shows the ratio of raw influent TSS to TBOD concentrations. For a typical domestic sewage system, this value ranges between 0.8 and 1.2. The median for watershed plants in 2023 was 1.06, similar to 2022, which is mid-typical range, slightly less compared to previous years.

Figure 22 shows a graph for the ratio of raw TKN to TBOD, with a range of 0.1 to 0.2 considered typical. The 2023 watershed median was 0.2, which is at the higher end of the typical range but similar to previous years. Higher ratios could be attributed to recycle streams, an industrial influence in the collection system, or the fact that most plants are now reporting TBOD, which may have been overestimated in previous years.

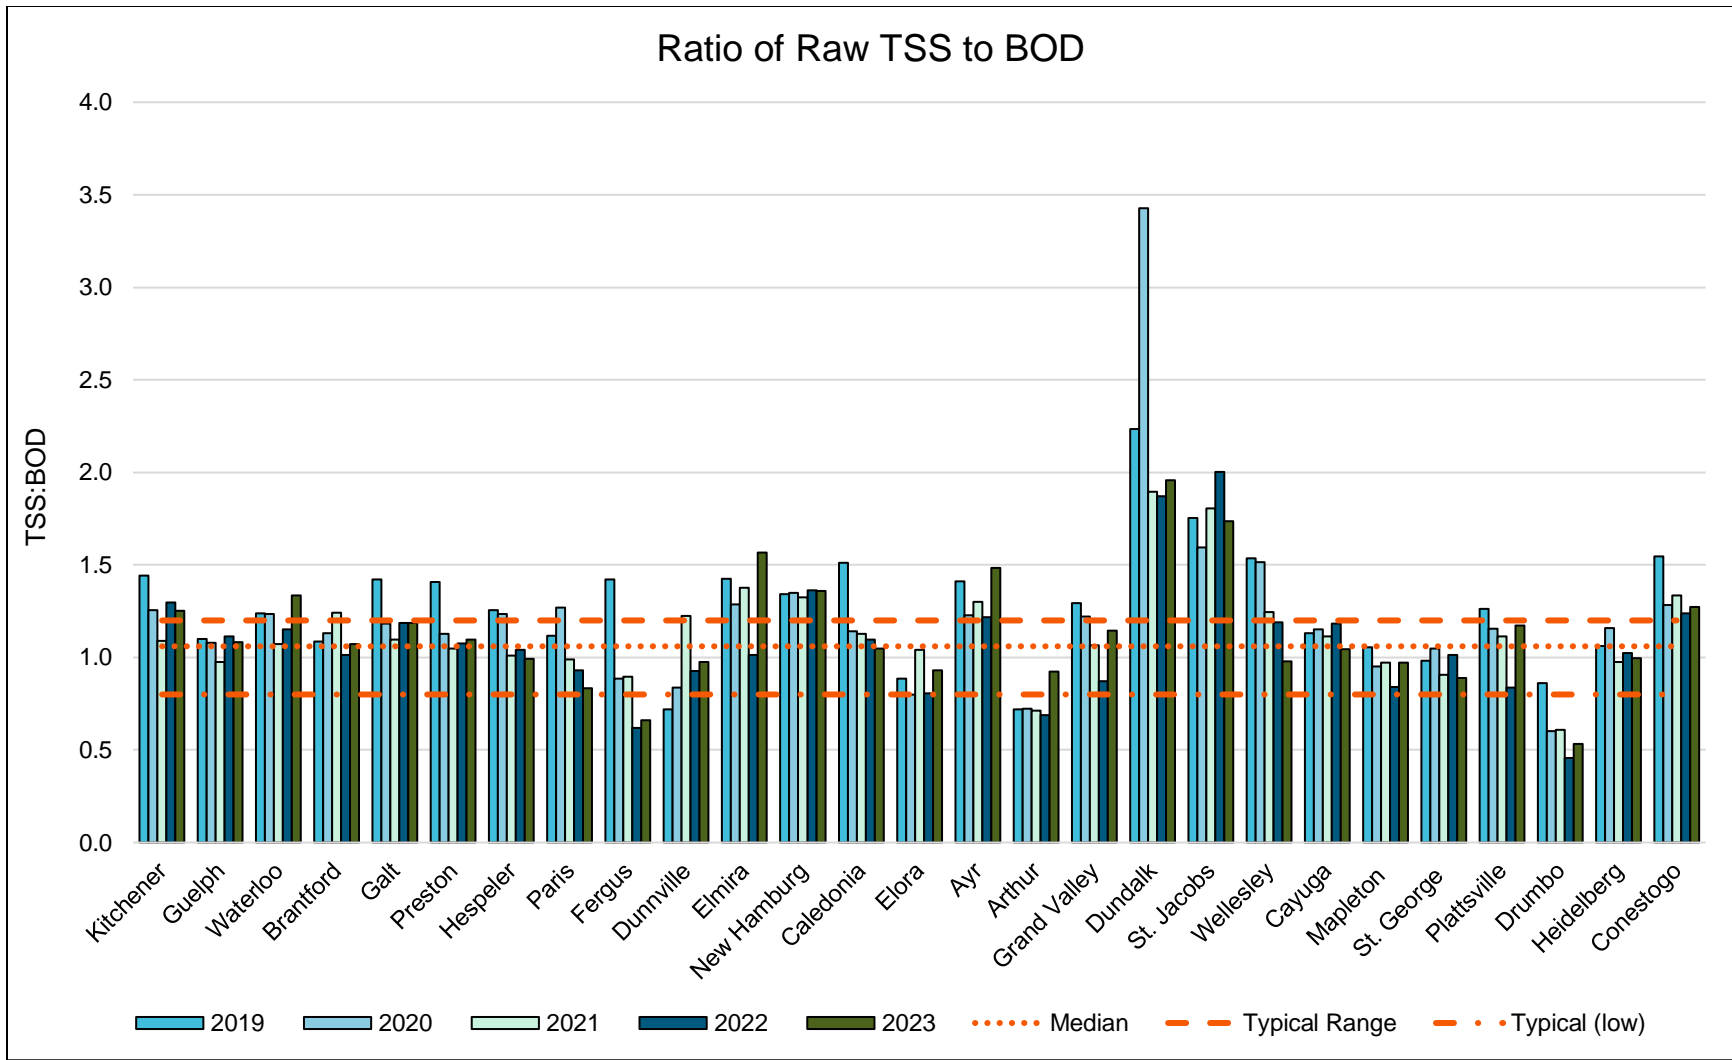


Figure 21: Ratio of Raw TSS to Raw TBOD

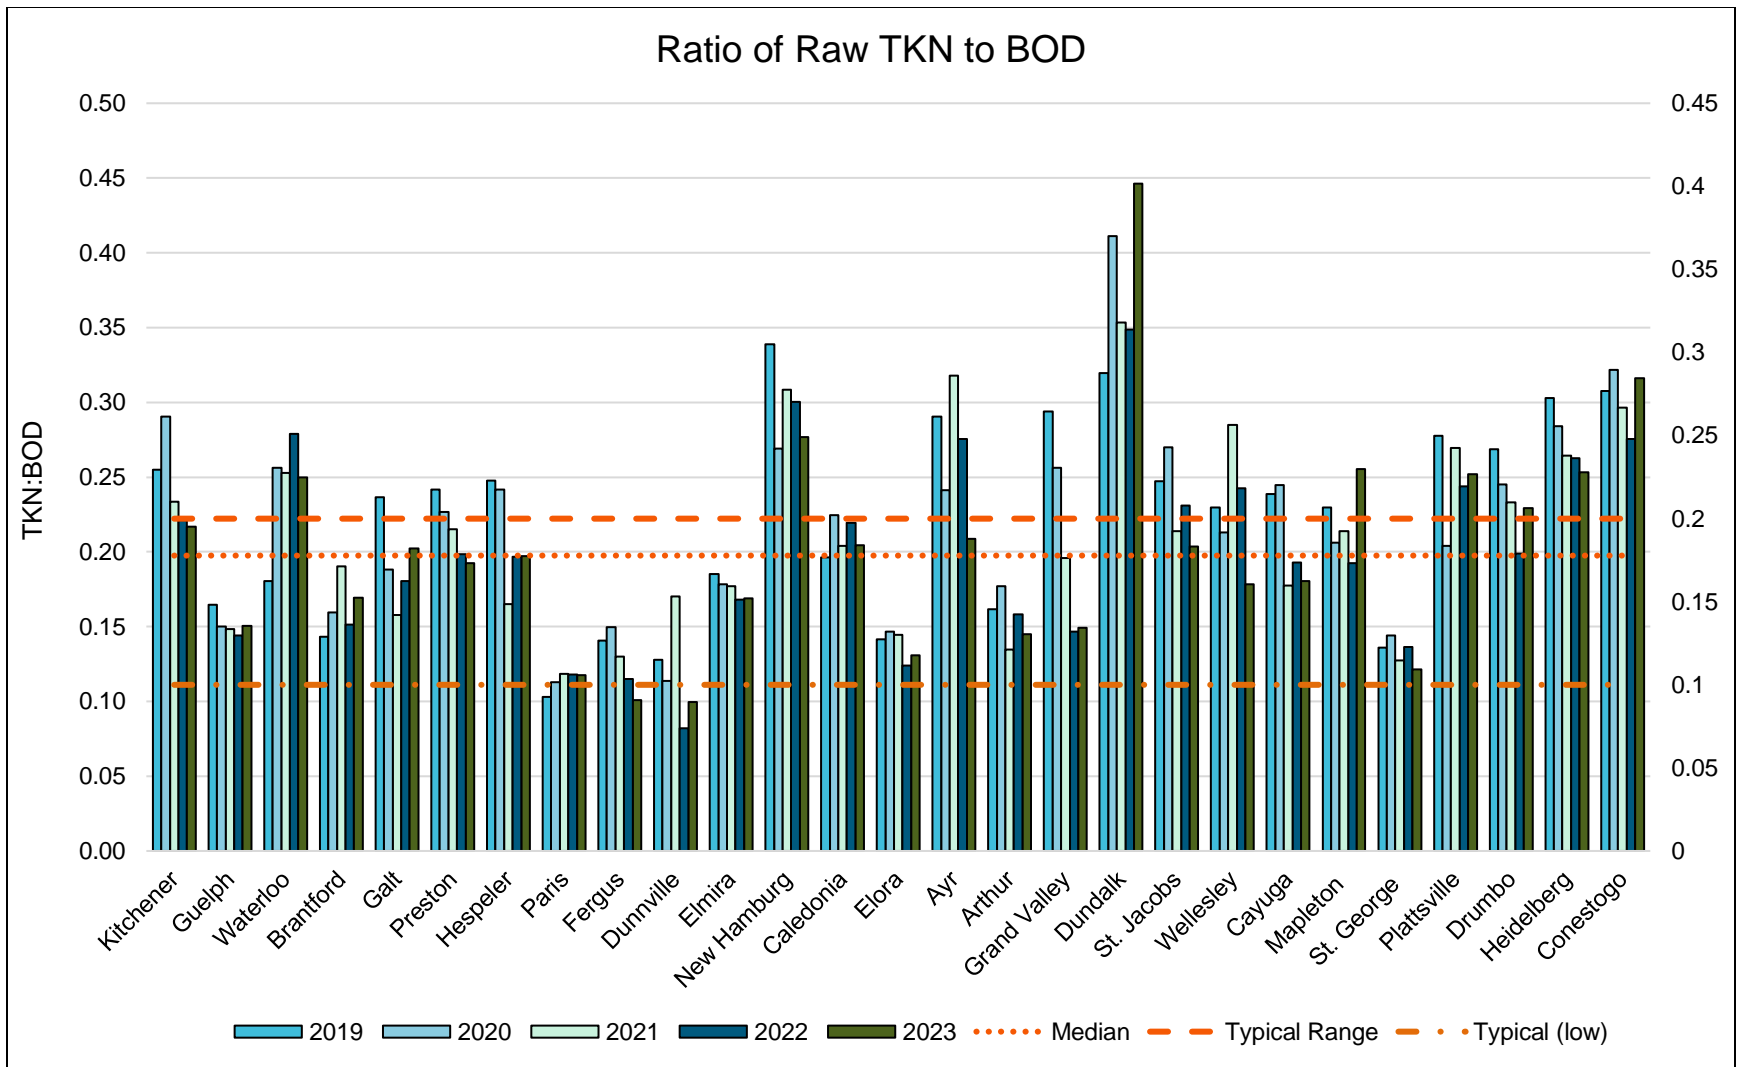


Figure 22: Ratio of Raw TKN to Raw TBOD

FINAL COMMENTS

The information presented in this report documents that effluent quality has improved since 2012 as a result of facility upgrades and optimization. These improvements have led to significant reductions in TP and TAN discharged to the Grand River.

However, 2023 is the first year in recent years that both TP and TAN loading increased compared to the previous year. Five of the eight largest plants in the watershed did not consistently achieve their TP target in 2023. TP loading increased from 21.1 tonnes in 2022 to 23.3 tonnes in 2023, a 10% increase. TAN loading also increased compared to the previous year, from 58 tonnes in 2022 to 75 tonnes in 2023, an increase of 29% .

As part of the ongoing watershed-wide wastewater optimization program, the GRCA will continue to encourage and support municipalities to report on these performance and loading metrics on an annual basis. Tracking these metrics over time will document the effectiveness of the program and help to identify candidates that may benefit from further optimization activities.

The authors thank Ministry of Environment, Conservation and Parks (MECP) for financial contribution, and WWOP participants for their efforts at voluntary reporting and encourage them to consider adopting and reporting against the Water Management Plan voluntary effluent quality performance targets for TP and TAN. By embracing an optimization approach to reduce these nutrients in wastewater effluent, municipalities can help to ensure a healthy and sustainable watershed that supports prosperous and growing communities into the future.

Further information on the Grand River Watershed-wide Optimization Program can be obtained from the Grand River wastewater optimization [web page](#), or by contacting [Simion Tolnai](#), the Optimization Extension Specialist at 519-621-2761 Extension 2295 or [Cameron Irvine](#) at 519-621-2761 Extension 2234.

BIBLIOGRAPHY

- Albertson, O. (1995). Is the cBOD5 Test Viable for Raw and Settled Wastewater? *Journal of Environmental Engineering*, 515-520.
- Anderson et al., 2. (2011). Watershed-wide Wastewater Optimization Pilot Project for the Grand River Watershed. *WEAO 2011 Technical Conference*. Toronto, ON.
- Canada-Ontario Agreement Partners. (2018). *Partnering on Achieving Phosphorus Loading Reductions to Lake Erie from Canadian Sources*. Environment and Climate Change Canada and the Ontario Ministry of the Environment and Climate Change.
- Canadian Heritage Rivers System. (2017). *Grand River Designation*. Retrieved January 15, 2019, from Canada's National River Conservation Program: <http://chrs.ca/the-rivers/grand/designation/>
- Eddy, M. &. (2003). *Wastewater Enginmeering, Treatment and Reuse*. New York: McGraw-Hill.
- EPA, U. (1989). *Handbook: Retrofitting POTWs*. Cincinnati OH: Center for Environmental Research Information.
- Grand River Municipal Water Managers Working Group. (2009). *Best Practices: Municipal Wastewater Treatment Plant Bypass and Spill Prevention & Reporting in the Grand River Watershed*.
- GRCA. (2024). *Watershed-based Resource Management Strategy*. Cambridge, ON: Grand River Conservation Authority.
- Irvine, C. (2018). *Summary of Population Statistics for the Grand River Watershed*. Cambridge Ontario: Grand River Authority.
- LGL Limited. (2020). *Surface Water Quality Monitoring Program for the Grand and Nith Rivers*. Cambridge, Ontario.
- LGL Limited. (2024). *2023 Grand River Surface Water Quality Monitoring Program*. Cambridge, Ontario.
- LGL Limited. (2024). *Grand River Surface Water Quality Monitoring Program - 2023*.
- Limited, LGL. (2024). *2023 Grand River Surface Water Quality Monitoring Program*.
- Maccoux, M. J., Dove, A., Backus, S. M., & Dolan, D. M. (2016). Total and soluble reactive phosphorus loadings to Lake Erie A detailed accouting by year, basin, country and tributary. *Journal of Great Lakes Research*.
- Muirhead, W. F. (2006). Study of Raw Wastewater BOD5 and cBOD5 Relationship Yields Surprising Results. *WEFTEC 2006*, (pp. 840-853). Dallas TX.
- PAI & WTC. (1996). *The Ontario Composite Correction Program Manual for Optimization of Sewage Treatment Plants*. Prepared for Ontario Ministry of Environment and Energy, Environment Canada and The Municipal Engineers Association.
- Project Team. (2014). *Grand River Watershed Water Management Plan*. Cambridge ON: Grand River Conservation Authority.
- Shifflett, S. (2012). *Current Watershed Conditions as of December 11, 2012*. Cambridge ON: Report GM-12-12-90 to GRCA Board of Directors.
- Shifflett, S. (2013). *Current Watershed Conditions as of December 10, 2013*. Cambridge ON: Report GM-12-13-149 to GRCA Board of Directors.
- Shifflett, S. (2014). *Current Watershed Conditions as of December 9, 2014*. Cambridge ON: Report 12-14-139 to GRCA Board of Directors.

- Shifflett, S. (2016). *Current Watershed Conditions as of January 20, 2016*. Cambridge ON: Report GM-01-16-10 to GRCA Board of Directors.
- Shifflett, S. (2017). *Current Watershed Conditions as of December 6, 2017*. Cambridge, ON: Report GM-12-17-136 to Members of the GRCA.
- Shifflett, S. (2017). *Current Watershed Conditions as of January 27, 2017*. Cambridge ON: Report GM-01-17-15 to GRCA Board of Directors.
- Shifflett, S. (2018). *Current Watershed Conditions as of December 5, 2018*. Cambridge: GM-12-18-124 Report to Members of the GRCA.
- Shifflett, S. (2019). *Current Watershed Conditions as of December 4, 2019*. Report GM-12-19-125 To Members of the GRCA.
- Shifflett, S. (2021). *Current Watershed Conditions as of December 8, 2021*. Report GM-12-21-99 to Members of the GRCA.
- Taleban, V. (2023). *Current Watershed Conditions as of December 6, 2023. Report GM-12-23-103 to Members of the GRCA*. Cambridge: Grand River Conservation Authority.
- WEAO. (2010). *Optimization Guidance Manual for Sewage Works*. Toronto: XCG Consultants.

APPENDIX 1: SLUDGE ACCOUNTABILITY AND WATER BALANCE SUMMARY

Table 12: Summary of sludge accountability analysis results

Year	2019			2020			2021			2022			2023		
WWTP	Projected	Reported	Analysis	Projected	Reported	Analysis	Analysis	Reported	Analysis	Projected	Reported	Analysis	Projected	Reported	Analysis
Kitchener	23,076	24,992	-8.3%	12,111	13,837	-14.2%	15,524	14,234	8.3%	17,057	17,591	-3.1%	23,303	23,527	-1.0%
Brantford	9,034	9,781	-8.3%	10,135	9,499	6.3%	8,553	8,877	-3.8%	10,105	8,737	13.5%	9,944	9,266	6.8%
Guelph	10,465	11,191	-6.9%	13,602	15,492	-13.9%	12,736	13,534	-6.3%	14,029	12,689	9.6%	14,161	12,744	10.0%
Galt	8,500	8,763	-3.1%	9,071	7,727	14.8%	10,030	7,455	25.7%	7,632	7,274	4.7%	7,935	9,084	-14.5%
Waterloo	17,412	14,123	18.9%	9,662	8,937	7.5%	8,630	7,343	14.9%	10,419	10,798	-3.6%	17,107	18,940	-10.7%
Preston	2,669	2,449	8.2%	2,624	2,905	-10.7%	2,363	2,178	7.8%	2,880	3,091	-7.3%	2,977	2,805	5.8%
Hespeler	1,210	1,233	-1.9%	1,343	1,671	-24.4%	2,239	2,201	1.7%	1,633	1,471	9.9%	1,568	1,608	-2.5%
Fergus	1,924	1,469	23.6%	1,056	819	22.5%	1,251	1,521	-21.6%	Not reported			1075	728	32.3%
Elmira	1,856	2,005	-8.0%	1,559	1,990	-27.7%	1,712	2,039	-19.1%	1600	2164	-35.3%	2320	2214	4.6%
Dunnville	845	985	-16.7%	869	732	15.7%	793	788	0.6%	643	851	-32.2%	591	809	-36.8%
Caledonia	1,242	856	31.1%	974	900	7.6%	944	740	21.6%	1000	895	10.5%	1,113	907	18.5%
Paris	816	1,112	-36.2%	932	1,028	-10.3%	1,060	1,305	-23.1%	1142	987	13.5%	1048	1860	-77.5%
New Hamburg	575	1,540	-167.6%	717	1,435	-100.0%	734	1,083	-47.6%	698	816	-17.0%	735	608	17.3%
Elora	1,559	970	37.8%	1,215	715	41.2%	566	810	-43.1%	Note reported			536	387	27.7%
Ayr	247	266	-7.7%	271	280	-3.4%	268	294	-9.9%	306	246	19.6%	349	300	14.1%
Arthur	Not reported			Not reported			Not reported			209	266	-27.3%	Not reported		
St. Jacobs	170	167	1.2%	146	154	-5.4%	203	149	26.3%	155	136	12.2%	133	161	-20.7%
St. George	66	335	-410.9%	Not reported			190	258	-36.0%	139	206	-48.3%	205	367	-79.4%
Grand Valley	Not reported			Not reported			Not reported			101	105	-4.0%	Not reported		
Wellesley	171	156	9.1%	152	128	15.4%	139	117	15.9%	166	146	12.2%	238	217	8.7%
Cayuga	93	123	-31.5%	95	126	-32.2%	95	126	-32.2%	102	145	-42.1%	119	130	-9.0%
Drumbo	80	74	7.3%	91	101	-11.0%	91	95	-4.3%	98	87	11.6%	83	73	11.8%
Conestogo	14	11	19.9%	15	7	53.2%	16	14	11.0%	18	15	14.7%	15	16	-6.6%
Heidelberg	8	19	-125.0%	9	21	-119.3%	10	15	-51.5%	9	17	-83.0%	10	18	-82.0%

Table 13: Summary of Water Balance results from plants that report on it

Year	Plant	Dundalk	Mapleton	Plattsville	Cainsville
2016	Reported	28,101	48,910	Not Reported	Not Reported
	Projected	-17,969	-9,672		
	Influent Flow	380,883	215,158	Not Reported	Not Reported
	Water Balance (%)	-12.1%	-27.2%		
2017	Reported	60,260	Not Reported	17,107	Not Reported
	Projected	7,475		27,493	
	Influent Flow	404,642	Not Reported	196,483	Not Reported
	Water Balance (%)	-13.0%		5%	
2018	Reported	38,875	47,700	8,237.24	Not Reported
	Projected	-16,532	9,835	15,497	
	Influent Flow	380,477	233,250	172,542	Not Reported
	Water Balance (%)	14.6%	16.2%	-4.2%	
2019	Reported	23,292	Not Reported	20,381	1,968.2
	Projected	-33,731		15,522	-62,908
	Influent Flow	413,461	Not Reported	187,078	84,205
	Water Balance (%)	13.8%		2.6%	77%
2020	Reported	31,952	Not Reported	19,995	-6,547
	Projected	-8,490		31,550	-62,908
	Influent Flow	388,091	Not Reported	176,723	84,205
	Water Balance (%)	10.4%		-6.5%	67%
2021	Reported	34,984	Not Reported	7,102	1,725.7
	Projected	7,451		-19,290	-19,290
	Influent Flow	431,240	Not Reported	81,139.6	81,139.6
	Water Balance (%)	6.4%		26%	26%
2022	Reported	3,772	Not Reported	-15,208	-4,343
	Projected	-52,415		-32,987	-76,494
	Influent Flow	360,770	Not Reported	159,301	84,642
	Water Balance (%)	15.6%		11.2%	85.2%
2023	Reported	22,240	Not Reported	13,386	3,948
	Projected	-50,974		13,327	-75,325
	Influent Flow	431,398	Not Reported	160,848	95,278
	Water Balance (%)	17.0%		0.0%	83.2%